

Public Utility Commission of Texas

Texas Technical Reference Manual


Version 7.0

Volume 4: Measurement and Verification Protocols

Program Year 2020

Last Revision Date:

November 2019

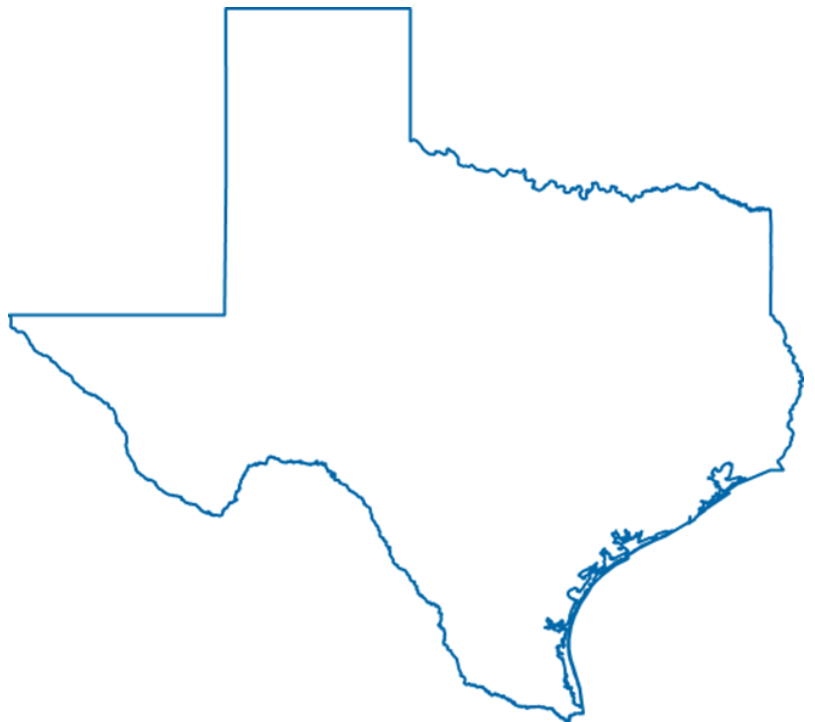

Public Utility Commission of Texas

Texas Technical Reference Manual

Version 7.0

Volume 4: Measurement and Verification Protocols

Program Year 2020

Last Revision Date:

November 2019

Table of Contents

1. Introduction	5
2. M&V Measures	7
2.1 M&V: HVAC	7
2.1.1 Air Conditioning Tune-ups Measure Overview	7
2.1.2 Ground Source Heat Pumps Measure Overview	20
2.1.3 Variable Refrigerant Flow Systems Measure Overview	27
2.2 M&V: Whole House	36
2.2.1 Residential New Construction Measure Overview	36
2.3 M&V: Renewables	48
2.3.1 Nonresidential Solar Photovoltaics (PV) Measure Overview	48
2.3.2 Residential Solar Photovoltaics (PV) Measure Overview	63
2.3.3 Solar Shingles Measure Overview	77
2.4 M&V: Miscellaneous	83
2.4.1 Behavioral Measure Overview	83
2.4.2 Air Compressors less than 75 hp Measure Overview	89
2.4.3 Commercial Retro-commissioning	95
2.4.4 Thermal Energy Storage Measure Overview	100
2.5 M&V: Load Management	104
2.5.1 Residential Load Curtailment Measure Overview	104
2.5.2 Nonresidential Load Curtailment Measure Overview	111
 APPENDIX A: M&V Metering Schedule	 121
APPENDIX B: Counties by Weather Zone Assignment	123

List of Figures

Figure 1. PVWatts® Input Screen for Step 1	50
Figure 2. PVWatts® Input Screen for Step 2	51
Figure 3. PVWatts® Input Screen for Step 3	52
Figure 4. PVWatts® Output Screen for Step 4	53
Figure 5. PVWatts® Output Screen for Step 4 (continued)	53
Figure 6. Weather Zone Determination for Solar PV Systems	55
Figure 7. Application of the Weather Zone Map.	60
Figure 8. PVWatts® Input Screen for Step 1	65
Figure 9. PVWatts® Input Screen for Step 2	66

Figure 10. PVWatts® Input Screen for Step 3.....	67
Figure 11. PVWatts® Output Screen for Step 4.....	68
Figure 12. PVWatts® Output Screen for Step 4 (continued).....	69
Figure 13. Weather Zone Determination for Solar PV Systems	71
Figure 14. PVWatts® Output Showing Geographic Coordinates.....	75
Figure 15. Application of the Weather Zone Map	76
Figure 16: Texas Technical Reference Manual Weather Zones.....	79

List of Tables

Table 1: Residential and Nonresidential M&V Savings by Measure Category	6
Table 2: AC Tune-up Efficiency Loss Factors.....	14
Table 3: Recommended Power Factors for AC Components	14
Table 4: AC Air Flow Determination Methods for Estimating Cooling Capacity at Test Out...	15
Table 5: EER Adjustment Factor and Capacity Adjustment Factor Constants	15
Table 6: Constants for Saturation Pressure Over Liquid Water Calculation	15
Table 7: AC Tune-up Toolkit Components.....	16
Table 8: Measurement Resolution and Accuracy	17
Table 9: M&V AC Tune-up Revision History	19
Table 10: Minimum Efficiency Levels for Commercial Single Stage GSHPs	21
Table 11: M&V Ground Source Heat Pumps Revision History	26
Table 12: Baseline Efficiency Levels for Electrically Operated VRF ACs and HPs	28
Table 13: M&V Variable Refrigerant Systems Revision History	35
Table 14: New SF and MF Construction up to Three Stories—Reference Home Characteristics	39
Table 15: New Multifamily Buildings greater than Three Stories—Baseline Characteristics ..	41
Table 16: M&V New Construction Revision History	47
Table 17: Module Type Options.....	49
Table 18. Climate Zone 1 Amarillo - Summer Demand kW Savings	56
Table 19. Climate Zone 1 Amarillo - Winter Demand kW Savings.....	56
Table 20. Climate Zone 2 Dallas - Summer Demand kW Savings	56
Table 21. Climate Zone 2 Dallas - Winter Demand kW Savings	57
Table 22. Climate Zone 3 Houston - Summer Demand kW Savings	57
Table 23. Climate Zone 3 Houston - Winter Demand kW Savings	57
Table 24. Climate Zone 4 Corpus Christi - Summer Demand kW Savings.....	58
Table 25. Climate Zone 4 Corpus Christi - Winter Demand kW Savings.....	58
Table 26. Climate Zone 5 El Paso - Summer Demand kW Savings	58

Table 27. Climate Zone 5 El Paso - Winter Demand kW Savings	59
Table 28. PVWatts® Output Showing Geographic Coordinates.....	59
Table 29: M&V Nonresidential Solar PV Revision History	62
Table 30. Module Type Options.....	64
Table 31. Climate Zone 1 Amarillo - Summer Demand kW Savings	72
Table 32. Climate Zone 1 Amarillo - Winter Demand kW Savings.....	72
Table 33. Climate Zone 2 Dallas - Summer Demand kW Savings	72
Table 34. Climate Zone 2 Dallas - Winter Demand kW Savings	73
Table 35. Climate Zone 3 Houston - Summer Demand kW Savings	73
Table 36. Climate Zone 3 Houston - Winter Demand kW Savings	73
Table 37. Climate Zone 4 Corpus Christi - Summer Demand kW Savings.....	74
Table 38. Climate Zone 4 Corpus Christi - Winter Demand kW Savings.....	74
Table 39. Climate Zone 5 El Paso - Summer Demand kW Savings	74
Table 40. Climate Zone 5 El Paso - Winter Demand kW Savings	75
Table 41: M&V Residential Solar PV Revision History	79
Table 42: TMY Data File by TRM Weather Zone.....	79
Table 43: M&V Solar Shingles Revision History	82
Table 44: M&V Behavioral Revision History	88
Table 45: Air Compressor Energy Factors.....	90
Table 46: Air Compressors less than 75 HP Revision History	94
Table 47: Commercial Retro-commissioning Revision History	99
Table 48: Thermal Energy Storage Revision History	103
Table 49. High 3 of 5 Example Load Management Event Data	107
Table 50: M&V Residential Load Management History	110
Table 51: Minimum Facility Demand Savings by Utility	112
Table 52: Peak Demand Period by Utility	112
Table 53: Utility Program Details Overview	114
Table 54: AEP (TNC & TCC) Interruption Options.....	114
Table 55: AEP (SWEPCO) Interruption Options.....	114
Table 56: Xcel Interruption Options	115
Table 57. High 5 of 10 Example Load Management Event Data.....	117
Table 58: M&V Nonresidential Load Management History	120

Acknowledgments

The Technical Reference Manual is maintained by the Public Utility Commission of Texas' independent Evaluation, Monitoring, and Verification (EM&V) team led by Tetra Tech.

This version of the Texas Technical Reference Manual was primarily developed from program documentation and measure savings calculators used by the Texas Electric Utilities and their Energy Efficiency Services Providers (EESPs) to support their energy efficiency efforts, and original source material from petitions filed with the Public Utility Commission of Texas by the utilities, their consultants and EESPs such as Frontier Associates (TXu 1-904-705), ICF, CLEAResult and Nexant. Portions of the Technical Reference Manual are copyrighted 2001-2016 by the Electric Utility Marketing Managers of Texas (EUMMOT), while other portions are copyrighted 2001-2018 by Frontier Energy. Certain technical content and updates were added by the EM&V team to provide further explanation and direction as well as consistent structure and level of information.

TRM Technical Support

Technical support and questions can be emailed to the EM&V team's project manager (lark.lee@tetrattech.com) and PUCT staff (therese.harris@puct.texas.gov).

1. INTRODUCTION

This volume of the TRM contains Measurement and Verification (M&V) protocols for determining and/or verifying utility claimed energy and demand savings for particular measures or programs ((§ 25.181(q)(6)(A))). Table 1 provides an overview of the M&V measures contained within Volume 4 and the types of savings estimates available for each one.

M&V protocols are included for the following measures:

- HVAC: Air Conditioning Tune-up
- HVAC: Ground Source Heat Pump
- HVAC: Variable Refrigerant Flow Systems
- Whole House: Residential New Construction
- Renewables: Nonresidential Solar Photovoltaics
- Renewables: Residential Solar Photovoltaics
- Renewables: Solar Shingles
- Miscellaneous: Behavioral
- Miscellaneous: Air Compressors less than 75 hp
- Miscellaneous: Commercial Retro-commissioning
- Miscellaneous: Thermal Energy Storage
- Load Management: Residential Load Curtailment
- Load Management: Nonresidential Load Curtailment

This is an update to TRM 3.1 that includes M&V protocols. Additional M&V protocols will be included in future versions of TRM Volume 4 as they are submitted, reviewed, and approved by the EM&V team and Commission staff.

Please consult Volume I: Overview and User Guide, Section 4: Structure and Content, for details on the organization of the measure templates presented in this volume.

Table 1: Residential and Nonresidential M&V Savings by Measure Category

Sector	Measure Category	Measure Description	6.0 Update
Residential and Nonresidential	HVAC	Air Conditioning Tune-up	No revisions.
Nonresidential	HVAC	Ground Source Heat Pump	Combined minimum efficiency levels into a single table. Added formulas for winter peak heating savings.
Residential and Nonresidential	HVAC	Variable Refrigerant Flow Systems	Minor formula corrections.
Residential	Whole House	Residential New Construction	Added provision for multi-family new construction, updated baseline to reflect the adoption of IECC2015
Residential and Nonresidential	Renewables	Solar Photovoltaics	No revisions.
Residential and Nonresidential	Renewables	Solar Shingles	No revisions.
Nonresidential	Miscellaneous	Behavioral	No revisions.
Nonresidential	Miscellaneous	Air Compressors Less Than 75hp	No revisions.
Nonresidential	Miscellaneous	Commercial Retro-commissioning	Clarifications for small project exemptions and proper use of IPMVP Option C. Correction for erroneous eligibility criteria in v6.0.
Nonresidential	Miscellaneous	Thermal Energy Storage	TRM v7.0 origin.
Residential	Load Management	Residential Load Curtailment	No revisions.
Nonresidential	Load Management	Nonresidential Load Curtailment	No revisions.

2. M&V MEASURES

2.1 M&V: HVAC

2.1.1 Air Conditioning Tune-ups Measure Overview

TRM Measure ID: R-HV-TU and NR-HV-TU

Market Sector: Residential and commercial

Measure Category: HVAC

Applicable Building Types: Residential; commercial

Fuels Affected: Electricity

Decision/Action Type(s): Operation and maintenance (O&M)

Program Delivery Type(s): Custom

Deemed Savings Type: Deemed efficiency loss factors are applied to measured operating performance indicators to estimate energy saving impacts. The deemed efficiency loss factors estimate equipment improvements based on each unit's specific operating conditions.

Savings Methodology: Algorithms, EM&V, and deemed efficiency loss corresponding to whether refrigerant charge was adjusted

AC tune-ups promote a holistic approach to improve the operational efficiency of existing air conditioners by completing six tune-up service measures. This protocol is used to estimate savings for tune-up measures through an M&V approach that relies on test-out measurements of key AC performance indicators following completion of all tune-up service measures.

The M&V protocols are for air conditioner tune-ups (AC tune-up) for equipment where the six tune-up service measures are completed by professional air conditioning technicians. Tuned air conditioners are then performance tested under protocol conditions to ensure the AC system is under significant load and at steady-state conditions prior to recording measurements. Compliance with these M&V protocols ensures reliable performance measurements to estimate the energy savings impacts from the combined effects of all six tune-up service measures.

Measure Description

AC tune-ups must be professionally completed by qualified air conditioning service technicians using measurement tools and equipment. This protocol covers assumptions made for baseline equipment efficiencies based on previous M&V tune-ups in Texas from 2011-2014. The energy savings estimations process is designed to efficiently estimate electric energy and demand savings attributable to each participating AC tune-up unit. Following the completion of the six service measures, the M&V methodology for tune-ups require in-field measurement and recording of AC performance parameters under protocol conditions to record *in situ*, post-tune-up, performance to calculate estimated energy impacts.

The AC tune-up requires completion of six tune-up service measure tasks listed below.

- Clean condenser surfaces
- Clean evaporator surfaces
- Clean blower assembly (fan blades, plenum interior)
- Verify filter is clean: change or clean as needed
- Verify airflow within 15 percent of 400 cubic feet per minute per ton; adjust as needed
- Check refrigerant charge; adjust as needed

Applicable equipment types include:

- Packaged and split air conditioners (DX or air-cooled)
- Packaged and split heat pumps (air-cooled)

Eligibility Criteria

This measure only applies to existing air conditioning equipment (split and packaged air conditioner and heat pump systems) that receive the tune-up. For an AC tune-up to be eligible to use the deemed efficiency loss factors and savings approach, the AC tune-up must include completion of the six tune-up service measures, and the following conditions must be met:

- Use of program specified measurement equipment and accuracies
- Tune-up completed by a qualified technician
- Document all service procedures completed during tune-up (e.g., clean AC components, verify airflow, and check/adjust refrigerant charge)

Baseline Condition

The baseline efficiency conditions are calculated (see Equation 7) based on the efficiency loss values determined by this protocol (see Table 2)

High-efficiency Condition

The high-efficiency conditions are calculated based on measurements taken in the field after the tune-up has been performed. These test-out (TO) measurements are then adjusted to Air-Conditioning Refrigeration and Heating Institute (AHRI) standard operating conditions to develop an in-situ post-tune-up high-efficiency condition. The equipment efficiency effects are used to estimate cooling and heating (heat pumps only) energy impacts as applicable.

Energy and Demand Savings Methodology

Savings Algorithms and Input Variables

$$\text{Energy Savings } [kWh_{\text{Savings}}] = kWh_{\text{Savings},C} + kWh_{\text{Savings},H}$$

Equation 1

$$\text{Peak Demand Savings } [kW_{\text{Savings},C}] = Cap_{\text{Rated}} \times \left(\frac{1}{\eta_{\text{pre},C}} - \frac{1}{\eta_{\text{post},C}} \right) \times CF \times \frac{kW}{1000 W}$$

Equation 2

$$\text{Energy (Cooling) } [kWh_{\text{Savings},C}] = Cap_{\text{Rated}} \times \left(\frac{1}{\eta_{\text{pre},C}} - \frac{1}{\eta_{\text{post},C}} \right) \times EFLH_C \times \frac{kW}{1000 W}$$

Equation 3

$$\text{Energy (Heating) } [kWh_{\text{Savings},H}] = Cap_{\text{Rated}} \times \left(\frac{1}{\eta_{\text{pre},H}} - \frac{1}{\eta_{\text{post},H}} \right) \times EFLH_H \times \frac{kW}{1000 W}$$

Equation 4

$$\eta_{\text{post},C} = \eta_{\text{TO},C} \times \text{EER Adjustment Factor}$$

Equation 5

$$\eta_{\text{pre},C} = (1 - \text{efficiency loss}) \times \eta_{\text{post},C}$$

Equation 6

$$\eta_{\text{post},H}^{(1)} = 0.3342 \times \eta_{\text{post},C}^{(2)} + 3.9871$$

Equation 7

$$\eta_{\text{pre},H} = (1 - \text{efficiency loss}) \times \eta_{\text{post},H}$$

Equation 8

$$\text{Test Out Efficiency } [\eta_{\text{TO},C}] = \frac{Cap_{\text{post},C}}{Power_{\text{TO},C}}$$

Equation 9

¹ Developed by Cadmus: 2013 Portfolio Evaluation, Entergy Arkansas, Appendix A

² For this protocol, the cooling efficiency of the existing equipment measured after tune-up and adjusted to AHRI standard conditions (i.e., $\eta_{\text{post},C}$) is used as a proxy for the post tune-up heating efficiency.

$$Cap_{post,C} = Cap_{TO,C} \times Capacity\ Adjustment\ Factor$$

Equation 10

$$Cap_{TO,C} = (h_{Return\ Air} - h_{Supply\ Air}) \times (Mass\ Flow\ Rate)$$

Equation 11

$$Enthalpy\ of\ Moist\ Air\ (Return\ Air/Supply\ Air), [h] = C_p \times t_{db} + W \times (1061 + 0.444 \times t_{db})$$

Equation 12

$$Specific\ Heat\ of\ Moist\ Air, [C_p]$$

$$= -2.0921943 \times 10^{-14} \times t_{db}^4 + 2.5588383 \times 10^{-11} \times t_{db}^3 + 1.2900877 \times 10^{-8} \times t_{db}^2 + 5.8045267 \times 10^{-6} \times t_{db} + 0.23955919$$

Equation 13

$$Humidity\ Ratio, [W] = \frac{(1093 - 0.556t_{wb})W_s - C_p(t_{db} - t_{wb})}{1093 + 0.444t - t_{wb}}$$

Equation 14

$$Saturation\ Humidity\ Ratio, [W_s] = (0.62198) \times \frac{p_{ws}}{p_{atm} - p_{ws}}$$

Equation 15

The Saturation Over Liquid Water equation is:

$$\ln(P_{ws}) = \frac{C_8}{T} + C_9 + C_{10} \times T + C_{11} \times T^2 + C_{12} \times T^3 + C_{13} \times \ln(T)$$

Equation 16

$$Saturation\ Pressure\ Over\ Liquid\ Water, [P_{ws}] = e^{\left[\frac{C_8}{T} + C_9 + C_{10} \times T + C_{11} \times T^2 + C_{12} \times T^3 + C_{13} \times \ln(T)\right]}$$

Equation 17

$$P_{atm} = \frac{29.92}{2.036} \times (1 - 6.8753 \times 10^{-6} \times Z)^{5.2559}$$

Equation 18

$$Mass\ Flow\ Rate = \frac{(CFM)}{(v_{Return\ Air})} \times \left(\frac{60\ minutes}{hour}\right)$$

Equation 19

$$Specific\ Volume\ (Return\ Air), [v_{Return\ Air}] = \frac{0.7543 \times (t_{db} + 459.67) \times (1 + 1.6078 \times W)}{P}$$

Equation 20

Note that if CFM (airflow) in Equation 19 is determined using method 2tt

(measured airspeed and duct grill dimensions), then the above CFM value is calculated using Equation 21.

$$\text{Air Flow, Method 2, [CFM]} = \text{Length} \times \text{Width} \times \text{Air Speed} \times \left(\frac{1 \text{ sq. ft.}}{144 \text{ sq. inch}} \right)$$

Equation 21

$$\text{Total Input Power [Power}_{TO}] = \text{Power}_{Blower}^{(3)} + \text{Power}_{Condenser}$$

Equation 22

$$\text{Blower Single Phase Power [Power}_{Blower}] = \text{Volts} \times \text{Amps} \times PF$$

Equation 23

$$\text{Condenser Three Phase Power [Power}_{Blower}] = \frac{V_1 + V_2 + V_3}{3} \times \frac{A_1 + A_2 + A_3}{3} \times \sqrt{3} \times PF$$

Equation 24

$$\text{Condenser Single Phase Power [Power}_{Condenser}] = \text{Volts} \times \text{Amps} \times PF$$

Equation 25

$$\text{Condenser Three Phase Power [Power}_{Condenser}] = \frac{V_1 + V_2 + V_3}{3} \times \frac{A_1 + A_2 + A_3}{3} \times \sqrt{3} \times PF$$

Equation 26

$$\text{EER Adjustment Factor} = D_1 + D_2 \times A + D_3 \times B + D_4 \times A^2 + D_5 \times B^2 + D_6 \times A \times B$$

Equation 27

$$\text{Capacity Adjustment Factor} = C_1 + C_2 \times A + C_3 \times B + C_4 \times A^2 + C_5 \times B^2 + C_6 \times A \times B$$

Equation 28

$$A = 10^\circ\text{F} - (\text{Wet Bulb}_{\text{Return Air}} - \text{Wet Bulb}_{\text{Supply Air}})$$

Equation 29

$$B = (95^\circ\text{F} - \text{Dry Bulb}_{\text{Outdoor}})$$

³ Blower power is only added if the AC system is split. If packaged, total input power is measured condenser power only as a packaged unit already includes the blower.

Where:

Cap_{Rated}	=	Rated nominal equipment cooling/heating capacity of the existing equipment at AHRI standard conditions [Btuh]; 1 ton = 12,000 Btuh
$Cap_{TO,C}$	=	Measured cooling capacity after tune-up [Btuh]; 1 ton = 12,000 Btuh
$\eta_{pre,C}$	=	Cooling efficiency of existing equipment before tune-up [Btuh/W]
$\eta_{post,C}$	=	Cooling efficiency of existing equipment measured after tune-up and adjusted to AHRI standard conditions [Btuh/W]
$\eta_{TO,C}$	=	Cooling efficiency of existing equipment measured after tune-up [Btuh/W]
$\eta_{pre,H}$	=	Heating efficiency of existing equipment before tune-up [HSPF]
$\eta_{post,H}$	=	Heating efficiency of existing equipment after tune-up and adjusted to AHRI standard conditions [Btuh/W]. For this protocol $\eta_{post,H}$ is a mathematical estimate based on the proxy for cooling efficiency of existing equipment measured after tune-up and adjusted to AHRI standard conditions (i.e., $\eta_{post,C}$)

Note: Use EER as efficiency “ η_C ” for kW and kWh cooling savings calculations. Use Heating Season Performance Factor (HSPF) as efficiency “ η_H ” for kW and kWh heating savings calculations.

$EFLH_{C/H}$	=	Cooling/heating equivalent full load hours for appropriate climate zone, building type, and equipment type [hours] (Residential Volume 2 Table 2-37 and Table 2-38); Nonresidential Volume 3 Table 2-16 through Table 2-20)
CF	=	Summer peak coincidence factor for appropriate climate zone, building type, and equipment type (Residential Volume 2 Equations 49 and 50); Nonresidential Volume 3 Tables 2-16 through Table 2-20)
Volts	=	Measured voltage (Volts) on single-phase electric power leads to AC components
Amps	=	Measured current flow (Amps) on single-phase electric power leads to AC components
PF	=	Power factor stipulated based on motor type (see Table 3)
V_1, V_2, V_3	=	Measured voltage, line to line on each of the three electric power leads (V_1, V_2, V_3) to AC components for 3-phase loads
A_1, A_2, A_3	=	Measured current flow (Amps) on each line (A_1, A_2, A_3) of the three power leads to AC components for 3-phase loads

<i>efficiency loss</i>	=	<i>Efficiency loss factor; derived from a significant sample of field measurement data for units with versus without a refrigerant charge and commercial versus residential unit types (see Table 2)</i>
<i>P</i>	=	<i>Measured total pressure of moist air [inches Mercury]</i>
<i>P_{ws}</i>	=	<i>Saturation pressure over liquid water [psia]</i>
<i>P_{atm}</i>	=	<i>Atmospheric pressure [psia]</i>
<i>v</i>	=	<i>Specific volume of air [cu.ft./lb]</i>
<i>Ln.</i>	=	<i>Natural Logarithm</i>
<i>e</i>	=	<i>Natural Log constant (2.7182818284590452353602874713527)</i>
<i>Z</i>	=	<i>Elevation-Altitude [feet]</i>
<i>T</i>	=	<i>Absolute temperature, Rankine scale [$^{\circ}R = ^{\circ}F + 459.67$]</i>
<i>t_{db}</i>	=	<i>Measured dry bulb temperature [$^{\circ}F$]</i>
<i>t_{wb}</i>	=	<i>Measured wet bulb temperature [$^{\circ}F$]</i>
<i>Wet Bulb_{Return Air}</i>	=	<i>Wet-bulb temperature of return air (load) to AC evaporator [$^{\circ}F$]</i>
<i>Wet Bulb_{Supply Air}</i>	=	<i>Wet-bulb temperature of cooled supply air to indoor space [$^{\circ}F$]</i>
<i>Dry Bulb_{Outdoor}</i>	=	<i>Dry-bulb temperature of outdoor air at time of tune-up [$^{\circ}F$]</i>
<i>h_{Return Air}</i>	=	<i>Measured enthalpy of return air (load) to AC evaporator [Btu/lb]</i>
<i>h_{Supply Air}</i>	=	<i>Measured enthalpy of cooled supply air to indoor space [Btu/lb]</i>
<i>Mass Flow Rate</i>	=	<i>Measured heat carrying capacity of moist return air [lb/hr]</i>
<i>CFM</i>	=	<i>AC supply/return air flow [cu.ft./min.] (Method 1 see Table 4)</i>
<i>Length</i>	=	<i>Measured length of duct grill long side [inches] (Method 2)</i>
<i>Width</i>	=	<i>Measure width of duct grill short side [inches] (Method 2)</i>
<i>Air Speed</i>	=	<i>Measured air velocity at duct grille [feet per second] (Method 2)</i>
<i>95°F</i>	=	<i>95 degrees Fahrenheit is the outdoor dry bulb temperature at AHRI test conditions</i>
<i>10°F</i>	=	<i>10 degrees Fahrenheit is the typical wet bulb temperature change across an evaporator coil at AHRI conditions</i>

Energy and Demand Savings Tables

Efficiency Loss Factors

The baseline efficiency conditions (η_{pre}) are calculated using the measured post service test-out (η_{TO}) and AHRI adjusted (η_{post}) value in combination with the appropriate *efficiency loss* value for that tune-up. The efficiency loss factors as described in Table 2 below, are dependent on whether a refrigerant charge adjustment was made to the air conditioning unit as part of the tune-up. The efficiency loss factors are also different between unit sizes as well as distinct between the sector types. Therefore, efficiency losses should be developed separately for those with and without a refrigerant charge and residential versus commercial units.

Table 2: AC Tune-up Efficiency Loss Factors

Market Sector	Refrigerant Charge Adjusted
Residential	No
	Yes
Commercial	No
	Yes

Power Factors

Capturing power factors from units in the field can be difficult. Stipulating these factors is acceptable and suggested power factor values are presented by motor type for packaged and split system AC and heat pump units in Table 3.

Table 3: Recommended Power Factors for AC Components

Power Factors for AC Components	
Motor Type	Power Factor
Blower: Electrically Commutated Motor (ECM)	0.68
Blower: Permanent-Split Capacitor Motor (PSC)	0.98
Blower: Three Phase	0.98
Outdoor Condensing unit	0.85
Variable Frequency Drive (Single Phase)	0.87
Variable Frequency Drive (Three Phase)	0.65

Coincidence factor (CF) and equivalent full-load hour (EFLH) values

Residential: The reader is referred to TRM Volume 2 for deemed peak demand coincidence factor (CF) and equivalent full-load hour (EFLH) values for residential building types by climate zone for central AC or heat pump units.

Nonresidential: The reader is referred to TRM Volume 3 for deemed peak demand coincidence factor (CF) and equivalent full-load hour (EFLH) values by building type and climate zone for packaged and split AC and heat pump units.

Cooling Load Calculation

The cooling capacity ($Cap_{TO,C}$) of the AC unit is calculated automatically from technician measurements at test-out by the data collection and tracking system software using supply and return air enthalpy measurements and the volumetric airflow (CFM) according to the Equation 19. There are two methods for estimating the airflow rate: method 1) direct air velocity measurements combined with air-grille dimensions times velocity (in feet per second) times 60 minutes per hour [$CFM = (grill\ area\ ft^2) \times (airspeed\ in\ feet\ per\ minute)$]; or, method 2) the technician may select an estimate of airflow using manufacturer's fan charts.

The two methods for determining AC system airflow values following completion of the AC tune-up at test out are summarized in Table 4 below.

Table 4: AC Air Flow Determination Methods for Estimating Cooling Capacity at Test Out

Method for Estimating AC Air Flow	Data Source
Method 1: Handheld anemometer, grill dimension measurements; cfm calculation	L = Air intake grille length (in feet) W = Air intake grille width (in feet) S = Speed of airflow (feet per minute)
Method 2: Generic manufacturer fan charts	Select airflow (CFM) value based on closest match to: <ul style="list-style-type: none"> • External static pressure • Nominal tons • Blower speed • Belt horsepower

Table 5: EER Adjustment Factor and Capacity Adjustment Factor Constants

EER Adjustment Factor and Capacity Adjustment Factor Constants ⁴	
$C_1 = 1.013421588$	$D_1 = 1.003933337$
$C_2 = 0.017697661$	$D_2 = 0.016648337$
$C_3 = -0.006686796$	$D_3 = -0.006686796$
$C_4 = -0.000931159$	$D_4 = -0.000933205$
$C_5 = 8.04838 \times 10^{-5}$	$D_5 = 0.000222327$
$C_6 = -3.59283 \times 10^{-5}$	$D_6 = -0.000169511$

Table 6: Constants for Saturation Pressure Over Liquid Water Calculation

Saturation Pressure Over Liquid Water Constants ⁵	
$C_8 = -1.0440397 \text{ E} + 04$	$C_{11} = 1.2890360 \text{ E} - 05$
$C_9 = -1.1294650 \text{ E} + 01$	$C_{12} = -2.4780681 \text{ E} - 09$
$C_{10} = -2.7022355 \text{ E} - 02$	$C_{13} = 6.5459673 \text{ E} + 00$

Metering Plan

⁴ EER and Capacity AHRI adjustment factors and algorithms initially developed by Cadmus for Tune-up programs in Texas.

⁵ Developed by Cadmus: 2013 Portfolio Evaluation, Entergy Arkansas, Appendix A.

Equipment Required

The AC tune-up and approved savings protocols herein require the use of equipment in accordance with the toolkit (with specified manufacturer and model numbers) to measure key AC performance parameters in the field. The use of these tools or equivalent ensures consistent data acquisition conformance by all parties. The equipment required in the toolkit is shown in Table 7 for reference.

Table 7: AC Tune-up Toolkit Components

Device	Use Area	Quantity
Approved Digital Refrigerant Analyzer: <ul style="list-style-type: none"> Testo 556 Testo 560 Testo 550 iManifold 913-M and 914-M 	Refrigerant Charge Adjustment Refrigerant Pressure Refrigerant Temperature Super Heat Subcooling	1-2
Test 318-V Inspection Scope	Visual Coil Inspection	Optional
Spring clamp probes matched to the Testo A/C Analyzer	Refrigerant Line Temperatures	2
Testo 417 Large Vane Anemometer	Airflow	1
Testo 605-H2 Humidity Stick Or iManifold 911-M	Supply and Return Air Wet Bulb Temperature	2
Refrigeration hoses 5' NRP 45 Deg.	Refrigerant Pressure	Set of 3
Charging Calculator (R-22)	Refrigerant Charge	1
Charging Calculator (R-410A)	Refrigerant Charge	1
Testo 905-T1 Temperature Stick or Testo 605H Humidity stick Or iManifold 912-M or wired Outdoor Air temperature probe	Ambient Air Temperature	1
Testo 510 Compact Digital Manometer (or other digital manometer of comparable accuracy)	Static Pressure	1
Magnetic Static Pressure Tips	Static Pressure	2
Set of barbed hose tees	Static Pressure	1
1/8 mpt x barbed fitting	Static Pressure	1
10' silicone tubing	Static Pressure	1
Digital Volt/ Amp Meter	Voltage and Current	1
Ruler / Tape Measure	Duct and Grill Dimensions	1
Tablet computer or smartphone if using iManifold; OR: laptop or desktop to use for data entry if using the Testo kit components	AC Tune-up Application	1

Metering Schedule

A complete metering schedule identifying the AC tune-up process and measurements performed for AC tune-ups is presented in M&V Metering Schedule 2.5.2 APPENDIX A:. The technician follows the metering schedule during the tune-up process.

Equipment Accuracy

The accuracy for each required piece of metering equipment is shown in Table 8.

Table 8: Measurement Resolution and Accuracy

Device	Model Number	Measurement	Resolution	Accuracy
Inspection Scope	Testo 318-V	Visual Coil Inspection	N/A	N/A
Anemometer	Testo 417	Air Flow Velocity	0.01m/s ^[1]	±0.1m/s+1.5% of reading ^[1]
Manometer	Testo 510	Differential pressure	0.01 inH2O ^[1]	±0.01 inH2O (0-0.12 inH2O), ±0.02 inH2O (0.13-0.40 inH2O), ±(0.04 inH2O +1.5 % of reading) (rest of range) ^[1]
Refrigerant System Analyzer	Testo 556	Refrigerant Temperature	0.1°F ^[1]	±0.6°F ±1 digit ^[1]
		Refrigerant Pressure	0.1 psi ^[1]	±0.5% Full Scale ^[1]
	Testo 560	Refrigerant Temperature	0.1°F ^[1]	±0.6°F ±1 digit ^[1]
		Refrigerant Pressure	0.1 psi ^[1]	±0.5% Full Scale ^[1]
	Testo 550	Refrigerant Temperature	0.1°F ^[1]	±1.8°F + 1 digit ^[1]
		Refrigerant Pressure	0.1 psi ^[1]	±0.75% Full Scale + 1 Digit ^[1]
	iManifold 913-M and 914-M	Refrigerant Temperature	0.1°F ^[5]	±0.4°F ^[5]
		Refrigerant Pressure	0.1 psi ^[5]	±0.5% Full Scale ^[5]
DB/WB Thermometer	Testo 605-H2	Dry/Wet Bulb	0.1°F ^[1]	±0.9°F ^[1]
	iManifold 911-M	Temperature	0.1°F ^[5]	±0.4°F ^[5]
Surface Thermometer	Testo 905-T2	Condenser Ambient Air	0.1°F ^[1]	±1.8°F (-58 to +212°F) ^[1]
	iManifold 912-M	Temperature	0.1°F ^[5]	±0.4°F ^[5]
Volt/Amp Meter	Fluke 27-II ^[2]	Voltage	0.1 V ^[3]	±(0.5% +3) ^[3]
		Current	0.01 A ^[3]	±(1.5% +2) ^[3]
Ruler / Tape Measure	N/A	Air Grill Dimensions	1/8 in ^[4]	±1/16 in ^[4]

[1] Obtained from Testo product manuals www.testo.us.

[2] Fluke 27-II not required, but volt/amp meter used must meet or surpass accuracy listed.

[3] Obtained from Fluke 27-II product manual: <http://us.fluke.com>.

[4] Ruler must have 1/8 inch graduations or less.

[5] Obtained from Imperial iManifold product website <https://imanifold.com/imanifold/residential-hvac/>

Claimed Peak Demand Savings

A summer peak period value is used for this measure. Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Additional Calculators and Tools

Not applicable.

Measure Life and Lifetime Savings

The estimated useful life (EUL) of residential and commercial AC tune-ups is 5 years.⁶

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified and tracked within the program database to inform the evaluation and apply the savings properly.

- Decision/Action Type: O&M
- Building type
- Climate/weather zone
- Equipment type
- Equipment rated cooling and heating capacities
- Equipment cooling and heating efficiency ratings
- Equipment make and model
- Refrigerant type
- Refrigerant adjustment (added/removed, weight)
- Note which five remaining AC tune-up service measures were completed
- Test-out measured cooling capacity
- Test-out measured power inputs
- Test-out measured mass flow rate
- All other operating measurements and parameters listed in M&V protocol

References and Efficiency Standards

Petitions and Rulings

- PUCT Docket 36779—Provides EUL for HVAC equipment

⁶ GDS Associates, Inc. (2007). Measure Life Report: Residential and Commercial/Industrial Lighting and HVAC Measures. Prepared for The New England State Program Working Group; Page 1-3, Table 1.

- PUCT Docket 40885—Provides a petition to revise deemed savings values for Commercial HVAC replacement measures. Items covered by this petition and applicable to the tune-up measure include the following:
- Updated demand and energy coefficients for all commercial HVAC systems.
- PUCT Docket 41070—Provides energy and demand savings coefficients for an additional climate zone, El Paso, Texas. Prior to this filing, savings for the Dallas-Fort Worth area were used for El Paso, but Dallas-Fort Worth has a colder winter, somewhat more moderate summer, more sunshine, and less precipitation than El Paso.

Relevant Standards and Reference Sources

- ASHRAE 90.1-1999 (Residential Buildings)
- ANSI/ASHRAE/IES Standard 90.1-2010. Energy Standard for Buildings Except Low-Rise Residential Buildings. Table 6.8.1A through Table 6.8.1D.
- Code of Federal Regulations. Title 10. Part 431—Energy Efficiency Program for Certain Commercial and Industrial Equipment. <https://www.govinfo.gov/app/details/CFR-2013-title10-vol3/CFR-2013-title10-vol3-part431>

Document Revision History

Table 9: M&V AC Tune-up Revision History

TRM Version	Date	Description of Change
v3.0	4/10/2015	TRM v3.0 origin.
v3.1	11/05/2015	Major methodology updates include revising action/decision type from retrofit to O&M and establishing new efficiency loss factors by including 2014 measurements into the regression analysis. Revised measure details to match the layout of TRM volumes 2 and 3. Added detail regarding Measure Overview, Measure Description, Measure Life, Program Tracking Data and Evaluation Requirements, References and Efficiency Standards, and Document Revision History.
v4.0	10/10/2016	Revised efficiency loss factors based on 2015 results. Added VFD motor types.
v5.0	10/10/2017	Removed reference to deemed efficiency loss factors. Added clarity to separate units by refrigerant charge adjustments and unit size/type. Updated table references.
v6.0	10/2018	No revisions.
v7.0	10/2019	No revisions.

2.1.2 Ground Source Heat Pumps Measure Overview

TRM Measure ID: NR-HV-GH

Market Sector: Commercial

Measure Category: HVAC

Applicable Building Types: Commercial

Fuels Affected: Electricity

Decision/Action Types: Retrofit (RET)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V and whole facility measurement

This protocol is used to estimate savings for ground source heat pump (GSHP) measures through an M&V approach. The development of the GSHP M&V methodology is driven by the desire to create and implement a framework to provide high quality verified savings while not restricting the ability of program implementers to use the tools and systems they have developed. The protocol allows for flexibility in implementation while developing verified energy savings and balancing the risk associated with the uncertainty in the expected savings.

Measure Description

This measure requires the installation of a ground-source heat pump (GSHP) system replacing an existing heating, ventilating, and air conditioning (HVAC) system. Initial estimated savings are dependent upon the energy efficiency ratings and operational parameters of the existing systems being replaced by the new higher efficiency equipment efficiency ratings and operating parameters. The energy savings estimation process is designed to efficiently estimate electric energy and demand savings attributable to each GSHP system.

Applicable GSHP efficient measure types include:

- Single-Stage GSHP
- Multi-Stage GSHP
- Closed Loop GSHP
- Direct Geoexchange (DGX)
- Open Loop WSHP
- Water-to-Air
- Water-to-Water

Eligibility Criteria

This measure only applies when replacing an existing HVAC system with a new GSHP system. New construction GSHP systems are not eligible for applying this methodology.

Baseline Condition

Existing System Replacement: The baseline for retrofit projects is specific to the existing HVAC system being replaced by a new GSHP; that is, existing system manufacturer, model number, an AHRI nominal efficiencies, and operating parameters, define the baseline case.

High-efficiency Condition

High-efficiency conditions for GSHP equipment must meet applicable standards. AHRI energy ratings for EER and COP by manufacturer model numbers are established following required test protocols and parameters and must meet or exceed current DOE EERE and ASHRAE 90.1 minimum efficiency requirements as set forth in Table 10.

Water source heat pumps are verified using manufacturer specifications which clearly show the entering water temperature (EWT), gallons per minute (GPM), and the associated EER rating at ARI/ISO 13256-2 cooling conditions of 77°F EWT and 53.6°F leaving water temperature (LWT) ground loop.

Qualifying DXG GSHPs must be rated in accordance with AHRI 870 rating conditions.

Table 10: Minimum Efficiency Levels for Commercial Single Stage GSHPs⁷

System Type	Capacity (Btuh)	Cooling EWT Rating Condition	Minimum Cooling EER	Heating EWT Rating Condition	Minimum Heating COP
Water to Air (water loop)	< 17,000	86°F	12.2	68°F	4.3
	≥ 17,000 and < 135,000	86°F	13.0	68°F	4.3
Water to Air (groundwater)	< 135,000	59°F	18.0	50°F	3.7
Brine to Air (ground loop)	< 135,000	77°F	14.1	32°F	3.2
Water to Water (water loop)	< 135,000	86°F	10.6	68°F	3.7
Water to Water (groundwater)	< 135,000	59°F	16.3	50°F	3.1
Brine to Water (ground loop)	< 135,000	77°F	12.1	32°F	2.5

⁷ Values from ASHRAE 90.1-2013.

Energy and Demand Savings Methodology

Whole Facility EM&V Methodology (Used to Estimate Final Savings Potential)

A whole facility EM&V methodology presents a plan to determine energy savings from replacing an existing HVAC system with a new GSHP system to provide heating and cooling for a commercial facility. This methodology measures and verifies initial energy savings estimates. The plan follows procedures guided by whole facility Option C in the International Performance Measurement and Verification Protocol (IPMVP). The development of the whole facility measurement methodology is driven by the desire to create and implement a framework to provide high quality verified savings while keeping within the standards currently used by similar commercial heating, ventilating, and air conditioning (HVAC) measures in TRM Volume 3. The Whole Facility guidance is found in the latest version of the IPMVP Volume 1 EVO 10000-1:2012.

M&V Plan and M&V Report

Preparation of an M&V plan and ultimately an M&V report is a required to determine the savings. Advanced planning ensures that all data collection and information necessary for savings determination will be available after implementation of the measure(s). The project's M&V plan and M&V report provide a record of the data collected during project development and implementation. These documents may also serve multiple purposes throughout a project, including recording critical assumptions and in case conditions change. Documentation should be complete, readily available, clearly organized, and easy to understand.

The methodology described herein involves the use of whole facility electric meter data. An important component of the project is to identify the existing base and new case system information.

In addition to documenting existing and new equipment information, IPMVP describes the following requirements as part of the M&V plan and M&V report contents. These requirements are listed below, and the user is directed to the current version of IPMVP for further detail and guidance.

- Measure intent
- Selected IPMVP option and measurement boundary
- Baseline - period, energy, and conditions
- Reporting period
- Basis for adjustment
- Analysis procedure
- Energy prices (as applicable)
- Meter specifications
- Monitoring responsibilities
- Expected accuracy
- Budget (as applicable)

- Report Format
- Quality Assurance

The following equations will be used to calculate energy saving estimates:

$$\text{Peak Demand Savings (kW)}^8 = kW_{\text{Baseline}} - kW_{\text{New}}$$

Equation 31

Where:

kW_{Baseline} = The peak demand established for the measure load before the retrofit.

kW_{New} = The peak demand established for the measure load after the retrofit.

$$\text{Energy Savings (kWh)} = kWh_{\text{Baseline}} - kWh_{\text{New}}$$

Equation 32

Where:

kWh_{Baseline} = Annual energy consumption as determined by the regression equation, using the pre-retrofit degree-day and occupancy factors with post-retrofit temperature data from the measurement year.

kWh_{New} = Total annual energy consumption as reported in utility meter data for the post-retrofit measurement year.

Savings Algorithms and Input Variables (Used to Estimate Initial Savings Potential Only)

The follow savings algorithms are provided and are only to be used as an initial means to estimate energy savings prior to measure implementation.

The algorithms use current deemed peak demand coincidence factor (CF) and equivalent full-load hour (EFLH) values. The building type and climate zone must match those of the deemed lookup tables referenced herein. Otherwise, custom values for these inputs must be developed.

$$\text{Summer Peak Demand Savings } [kW_{\text{savings},C}] = \left(\frac{CAP_{\text{pre},C}}{\eta_{\text{pre},C}} - \frac{CAP_{\text{post},C}}{\eta_{\text{post},C}} \right) \times CF_C \times \frac{1kW}{1,000W}$$

⁸ TRM volume 1, section 4.2 provides a basis for estimating peak coincident demand reductions attributable to the implementation of energy efficiency measures in Texas. This is based on measure-specific load during the identified peak hours according to section 4.2.2.

Equation 33

$$\text{Winter Peak Demand Savings } [kW_{\text{Savings},H}] = \left(\frac{CAP_{pre,H}}{\eta_{pre,H}} - \frac{CAP_{post,H}}{\eta_{post,H}} \right) \times CF_H \times \frac{1kW}{3,412 \text{ Btuh}}$$

Equation 34

$$\text{Energy (Cooling) } [kWh_{\text{Savings},C}] = \left(\frac{CAP_{pre,C}}{\eta_{pre,C}} - \frac{CAP_{post,C}}{\eta_{post,C}} \right) \times EFLH_C \times \frac{1kW}{1,000W}$$

Equation 35

$$\text{Energy (Heating) } [kWh_{\text{Savings},H}] = \left(\frac{CAP_{pre,H}}{\eta_{pre,H}} - \frac{CAP_{post,H}}{\eta_{post,H}} \right) \times EFLH_H \times \frac{1kW}{3,412 \text{ Btuh}}$$

Equation 36

$$\text{Energy Savings } [kWh_{\text{Savings}}] = kWh_{\text{Savings},C} + kWh_{\text{Savings},H}$$

Equation 37

Note: Use EER as efficiency value for kW savings calculations and SEER/IEER and COP as efficiency value for kWh savings calculations. The COP expressed for units > 5.4 tons is a full-load COP. Heating efficiencies expressed as HSPF will be approximated as a seasonal COP and should be converted using the following equation:

$$\eta_{pre,H/post,H} = COP = \frac{HSPF}{3.412}$$

Equation 38

Where:

- $Cap_{pre,C/H}$ = Rated equipment cooling/heating capacity of the existing equipment at AHRI standard conditions [Btuh];
- $Cap_{post,C/H}$ = Rated equipment cooling/heating capacity of the newly installed equipment at AHRI standard conditions [Btuh];
- $\eta_{pre,C}$ = Cooling efficiency of existing equipment [Btu/W] (i.e., EER_{pre})
- $\eta_{post,C}$ = Rated cooling efficiency of new equipment (i.e., EER_{post} COP_{post})—(Must exceed baseline efficiency standards in Table 1) [Btu/W]
- $\eta_{pre,H}$ = Heating efficiency of existing equipment [COP]
- $\eta_{post,H}$ = Rated heating efficiency of the newly installed equipment—(Must exceed baseline efficiency standards in Table 1) [COP]
- $EFLH_{C/H}$ = Cooling/heating equivalent full load hours for appropriate climate zone, building type, and equipment type [hours] (Refer to Nonresidential Volume 3 Split System/Single Packaged AC and HP measure)

$CF_{C/H}$	=	Summer/winter peak coincidence factor for appropriate climate zone, building type, and equipment type (Refer to Nonresidential Volume 3 Split System/Single Packaged AC and HP measure)
$HSPF_{pre,H}$	=	Heating Season Performance Factor (HSPF) of existing equipment [BTU/W]
$HSPF_{post,H}$	=	Heating Season Performance Factor (HSPF) of newly installed equipment [BTU/W]
3.412	=	The amount of British Thermal Units (Btu) per hour in one watt (1 W = 3.412 Btuh)

Deemed Energy and Demand Savings Tables

Not applicable.

Claimed Peak Demand Savings

A summer peak period value is used for this measure. Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Additional Calculators and Tools

The regression software used for estimating annual energy use and demand should be clearly specified within the M&V plan and M&V report.

Measure Life and Lifetime Savings

The EUL for commercial split and packaged air conditioners and heat pumps is 15 years.⁹

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified and tracked within the program database to inform the evaluation and apply the savings properly.

- Decision/action type: ER system type conversion
- Building type
- Climate zone
- Baseline equipment type
- Baseline equipment rated cooling and heating capacities
- Baseline equipment cooling and heating efficiency ratings
- Baseline number of units

⁹ A 15-year EUL is cited in several places: PUCT Docket No. 36779, DOE 77 FR 28928, 10 CFR Part 431, and in the DEER 2014 update.

- Baseline age and method of determination (e.g., nameplate, blueprints, customer reported, not available)
- Installed equipment type
- Installed equipment rated cooling and heating capacities
- Installed equipment make and model
- Installed number of units
- Installed cooling and heating efficiency ratings

References and Efficiency Standards

Petitions and Rulings

- PUCT Docket 36779—Provides EUL for HVAC equipment.
- PUCT Docket 40885—Provides a petition to revise deemed savings values for Commercial HVAC replacement measures.
- PUCT Docket 41070—Provides energy and demand savings coefficients for an additional climate zone, El Paso, Texas. Prior to this filing, savings for the Dallas-Fort Worth area were used for El Paso, but Dallas-Fort Worth has a colder winter, somewhat more moderate summer, more sunshine, and less precipitation than El Paso.

Relevant Standards and Reference Sources

- ANSI/ASHRAE/IES Standard 90.1-2010. Energy Standard for Buildings Except Low-Rise Residential Buildings. Table 6.8.1A through Table 6.8.1D.
- Code of Federal Regulations. Title 10. Part 431—Energy Efficiency Program for Certain Commercial and Industrial Equipment. <https://www.govinfo.gov/app/details/CFR-2013-title10-vol3/CFR-2013-title10-vol3-part431>

Document Revision History

Table 11: M&V Ground Source Heat Pumps Revision History

TRM Version	Date	Description of Change
v3.1	11/05/2015	TRM v3.1 origin.
v4.0	10/10/2016	No revisions.
v5.0	10/10/2017	No revisions.
v6.0	10/2018	Combined minimum efficiency levels into a single table. Added formulas for winter peak heating savings.
v7.0	10/2019	No revisions.

2.1.3 Variable Refrigerant Flow Systems Measure Overview

TRM Measure ID: NR-HV-VR

Market Sector: Commercial

Measure Category: HVAC

Applicable Building Types: Commercial

Fuels Affected: Electricity

Decision/Action Types: Early retirement (ER), new construction (NC), and replace-on-burnout (ROB)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V and whole facility measurement, calculator

This protocol is used to estimate savings for variable refrigerant flow systems (VRF) measures through an M&V approach. The development of the VRF M&V methodology is driven by the desire to create and implement a framework to provide high quality verified savings while not restricting the ability of program implementers to use the tools and systems they developed. The protocol allows for flexibility in implementation while developing verified energy savings and balancing the risk associated with the uncertainty in the expected savings.

Measure Description

This measure requires the installation of a variable refrigerant flow (VRF) system replacing an existing heating, ventilating, and air conditioning (HVAC) system. Initial estimated savings are dependent upon the energy efficiency ratings and operational parameters of the existing systems being replaced by the new higher efficiency equipment efficiency ratings and operating parameters. The energy savings estimation process is designed to efficiently estimate electric energy and demand savings attributable to each VRF system.

Applicable VRF efficient measure types include:

- Air-cooled systems where multiple compressors are connected to a single refrigerant loop
- Water-cooled where multiple compressors are connected to a single water-source loop, which allows heat recovery between compressor units

Eligibility Criteria

This measure applies to replacing an existing HVAC system with a new VRF system or a new construction VRF system.

Baseline Condition

Early Retirement: The baseline for retrofit projects is specific to the existing HVAC system being replaced by a new VRF; that is, existing system manufacturer, model number, an AHRI nominal efficiencies, and operating parameters, define the baseline case. Alternatively, the use of a prescriptive savings calculation procedure for savings is allowed for existing system replacements, but the baseline must follow the new construction/replace-on-burnout procedure.

Replace-on-Burnout (ROB) and New Construction (NC): The baseline for ROB or NC projects is a code-minimum VRF system as specified by ASHRAE 90.1-2013. VRF system minimum efficiencies are not currently covered by IECC 2015. Minimum efficiency conditions are shown in Table 12 below. See the Deemed Energy and Demand Savings section below for more details.

High-efficiency Condition

High-efficiency conditions for VRF equipment must meet applicable standards. AHRI energy ratings for EER and COP by manufacturer model numbers are established following required test protocols and parameters and must meet or exceed current DOE EERE and ASHRAE 90.1 minimum efficiency requirements as set forth in Table 12. Both air-cooled and water-cooled systems are rated per AHRI Standard 1230.

Table 12: Baseline Efficiency Levels for Electrically Operated VRF ACs and HPs

System Type	Capacity [Btu/h]	Heating Section Type	Subcategory or Rating Condition	Baseline Efficiencies	Source
VRF Air Conditioners, Air Cooled	< 65,000	All	VRF multi-split system	13.0 SEER	ASHRAE 90.1-2013 Table 6.8.1-9
	≥ 65,000 and < 135,000	None or Electric Resistance		11.2 EER 13.1 IEER	
	≥ 135,000 and < 240,000			11.0 EER 12.9 IEER	
	≥ 240,000			10.0 EER 11.6 IEER	
VRF Air Cooled (cooling mode)	< 65,000	All	VRF multi-split system	13.0 SEER	ASHRAE 90.1-2013 Table 6.8.1-10
	≥ 65,000 and < 135,000	None or Electric Resistance	VRF multi-split system	11.0 EER 12.3 IEER	
			VRF multi-split system with heat recovery	10.8 EER 12.1 IEER	
	VRF multi-split system		10.6 EER 11.8 IEER		
	VRF multi-split system with heat recovery		10.4 EER 11.6 IEER		
	≥ 240,000		VRF multi-split system	9.5 EER 10.6 IEER	

System Type	Capacity [Btu/h]	Heating Section Type	Subcategory or Rating Condition	Baseline Efficiencies	Source
			VRF multi-split system with heat recovery	9.3 EER 10.4 IEER	
VRF Water Source (cooling mode)	< 65,000	All	VRF multi-split system 86°F entering water	12.0 EER	ASHRAE 90.1-2013 Table 6.8.1-10
			VRF multi-split system with heat recovery 86°F entering water	11.8 EER	
	≥ 65,000 and < 135,000		VRF multi-split system 86°F entering water	12.0 EER	
			VRF multi-split system with heat recovery 86°F entering water	11.8 EER	
	≥ 135,000		VRF multi-split system 86°F entering water	10.0 EER	
			VRF multi-split system with heat recovery 86°F entering water	9.8 EER	
VRF Air Cooled (heating mode)	< 65,000 (cooling capacity)	-	VRF multi-split system	7.7 HSPF	ASHRAE 90.1-2013 Table 6.8.1-10
	≥ 65,000 and < 135,000 (cooling capacity)		VRF multi-split system 47°F db/43°F wb outdoor air	3.3 COP _H	
			VRF multi-split system 17°F db/15°F wb outdoor air	2.25 COP _H	
	≥ 135,000 (cooling capacity)		VRF multi-split system 47°F db/43°F wb outdoor air	3.2 COP _H	
			VRF multi-split system 17°F db/15°F wb outdoor air	2.05 COP _H	
VRF Water Source (heating mode)	< 135,000 (cooling capacity)	-	VRF multi-split system 68°F entering water	4.2 COP _H	ASHRAE 90.1-2013 Table 6.8.1-10
	≥ 135,000 (cooling capacity)		VRF multi-split system 68°F entering water	3.9 COP _H	

Energy and Demand Savings Methodology

Whole Facility EM&V Methodology (Used to Estimate Final Savings Potential)

A whole facility EM&V methodology presents a plan to determine energy savings from replacing an existing HVAC system with a new VRF system to provide heating and cooling for a commercial facility. This methodology measures and verifies initial energy savings estimates. The plan follows procedures guided by whole facility Option C in the International Performance Measurement and Verification Protocol (IPMVP). The development of the whole facility measurement methodology is driven by the desire to create and implement a framework to provide high quality verified savings while keeping within the standards currently used by similar commercial heating, ventilating, and air conditioning (HVAC) measures in TRM Volume 3. The Whole Facility guidance is found in the latest version of the IPMVP Volume 1 EVO 10000-1:2012.

M&V Plan and M&V Report

Preparation of an M&V plan and ultimately an M&V report is a required to determine the savings. Advanced planning ensures that all data collection and information necessary to determine savings will be available after implementation of the measure(s). The project's M&V plan and M&V report provide a record of the data collected during project development and implementation. These documents may also serve multiple purposes throughout a project, including recording critical assumptions and in case conditions change. Documentation should be complete, readily available, clearly organized and easy to understand.

The methodology described herein involves the use of whole facility electric meter data. An important component of the project is to identify the existing base and new case system information.

In addition to documenting existing and new equipment information, IPMVP describes the following requirements as part of the M&V plan and M&V report contents. These requirements are listed below, and the user is directed to the current version of IPMVP for further detail and guidance.

- Measure intent
- Selected IPMVP option and measurement boundary
- Baseline - period, energy, and conditions
- Reporting period
- Basis for adjustment
- Analysis procedure
- Energy prices (as applicable)
- Meter specifications
- Monitoring responsibilities
- Expected accuracy
- Budget (as applicable)

- Report format
- Quality assurance

The following equations will be used to calculate energy saving estimates:

$$\text{Peak Demand Savings (kW)}^{10} = kW_{\text{Baseline}} - kW_{\text{New}}$$

Equation 39

Where:

kW_{Baseline} = The peak demand established for the measure load before the retrofit.

kW_{New} = The peak demand established for the measure load after the retrofit.

$$\text{Energy Savings (kWh)} = kWh_{\text{Baseline}} - kWh_{\text{New}}$$

Equation 40

Where:

kWh_{Baseline} = Annual energy consumption as determined by the regression equation, using the pre-retrofit degree-day and occupancy factors with post-retrofit temperature data from the measurement year.

kWh_{New} = Total annual energy consumption as reported in utility meter data for the post-retrofit measurement year.

Savings Algorithms and Input Variables (Used to Estimate Initial Savings Potential Only)

The follow savings algorithms are provided and are only to be used as an initial means to estimate energy savings prior to measure implementation.

The algorithms utilize current deemed peak demand coincidence factor (CF) and equivalent full-load hour (EFLH) values. The building type and climate zone must match those of the deemed look-up tables referenced herein. Otherwise, custom values for these inputs must be developed.

$$\text{Summer Peak Demand Savings } [kW_{\text{Savings},C}] = \left(\frac{CAP_{\text{pre},C}}{\eta_{\text{pre},C}} - \frac{CAP_{\text{post},C}}{\eta_{\text{post},C}} \right) \times CF_C \times \frac{1kW}{1,000W}$$

Equation 41

¹⁰ TRM volume 1, section 4.2 provides a basis for estimating peak coincident demand reductions attributable to the implementation of energy efficiency measures in Texas. This is based on measure-specific load during the identified peak hours according to section 4.2.2.

$$\text{Winter Peak Demand Savings } [kW_{\text{Savings},H}] = \left(\frac{CAP_{\text{pre},H}}{\eta_{\text{pre},H}} - \frac{CAP_{\text{post},H}}{\eta_{\text{post},H}} \right) \times CF_H \times \frac{1kW}{3,412 \text{ Btu/h}}$$

Equation 42

$$\text{Energy (Cooling)} [kWh_{\text{Savings},C}] = \left(\frac{CAP_{\text{pre},C}}{\eta_{\text{pre},C}} - \frac{CAP_{\text{post},C}}{\eta_{\text{post},C}} \right) \times EFLH_C \times \frac{1kW}{1,000W}$$

Equation 43

$$\text{Energy (Heating)} [kWh_{\text{Savings},H}] = \left(\frac{CAP_{\text{pre},H}}{\eta_{\text{pre},H}} - \frac{CAP_{\text{post},H}}{\eta_{\text{post},H}} \right) \times EFLH_H \times \frac{1kWh}{3,412 \text{ Btu}}$$

Equation 44

$$\text{Energy Savings } [kWh_{\text{Savings}}] = kWh_{\text{Savings},C} + kWh_{\text{Savings},H}$$

Equation 45

Note: Use EER as efficiency value for kW savings calculations and SEER/IEER and COP as efficiency value for kWh savings calculations. The COP expressed for units > 65,000 Btu/h is a full-load COP. Heating efficiencies expressed as HSPF will be approximated as a seasonal COP and should be converted using the following equation:

$$\eta_{\text{pre},H/\text{post},H} = COP = \frac{HSPF}{3.412}$$

Equation 46

Where:

- $Cap_{\text{pre},C/H}$ = Rated equipment cooling/heating capacity of the existing equipment at AHRI standard conditions [Btu/h];
- $Cap_{\text{post},C/H}$ = Rated equipment cooling/heating capacity of the newly installed equipment at AHRI standard conditions [Btu/h];
- $\eta_{\text{pre},C}$ = Cooling efficiency of existing equipment [Btu/W] (i.e., EER_{pre})
- $\eta_{\text{post},C}$ = Rated cooling efficiency of new equipment (i.e., EER_{post} COP_{post})—(Must exceed baseline efficiency standards in Table 1) [Btu/W]
- $\eta_{\text{pre},H}$ = Heating efficiency of existing equipment [COP]
- $\eta_{\text{post},H}$ = Rated heating efficiency of the newly installed equipment—(Must exceed baseline efficiency standards in Table 1) [COP]
- $EFLH_{C/H}$ = Cooling/heating equivalent full load hours for appropriate climate zone, building type, and equipment type [hours] (Refer to Nonresidential Volume 3 Split System/Single Packaged AC and HP measure)

$CF_{C/H}$	=	Summer/winter peak coincidence factor for appropriate climate zone, building type, and equipment type (Refer to Nonresidential Volume 3 Split System/Single Packaged AC and HP measure)
$HSPF_{pre,H}$	=	Heating Season Performance Factor (HSPF) of existing equipment [BTU/W]
$HSPF_{post,H}$	=	Heating Season Performance Factor (HSPF) of newly installed equipment [BTU/W]
3.412	=	The amount of British Thermal Units (Btu) per hour in one watt (1 W = 3.412 Btuh)

Deemed Energy and Demand Savings

For new construction, renovation, or existing system replacements (as an alternative compliance path), the use of a deemed savings procedure is available for claiming VRF system efficiency above code minimum efficiencies. The methodology is identical to TRM Volume 3 Split System/Single Packaged Air Conditioners and Heat Pumps by substituting the efficiencies from Table 12 as the baseline efficiencies for the New Construction and Replace on Burnout Energy and Demand Savings Methodology.

Claimed Peak Demand Savings

A summer peak period value is used for this measure. Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Additional Calculators and Tools

The regression software used to estimate annual energy use and demand should be clearly specified within the M&V plan and M&V report.

Measure Life and Lifetime Savings

The EUL for commercial split and packaged air conditioners and heat pumps is 15 years.¹¹

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified and tracked within the program database to inform the evaluation and apply the savings properly.

- Decision/action type: ER, ROB, NC, system type conversion
- Building type
- Climate zone
- Baseline equipment type

¹¹ A 15-year EUL is cited in several places: PUCT Docket No. 36779, DOE 77 FR 28928, 10 CFR Part 431, and in the DEER 2014 update.

- Baseline equipment rated cooling and heating capacities
- Baseline equipment cooling and heating efficiency ratings
- Baseline number of units
- For ER only: baseline age and method of determination (e.g., nameplate, blueprints, customer reported, not available)
- Installed equipment type
- Installed equipment rated cooling and heating capacities
- Installed equipment make and model
- Installed number of units
- Installed cooling and heating efficiency ratings
- For other building types only: description of the actual building type, the primary business activity, the business hours, and the HVAC schedule

References and Efficiency Standards

Petitions and Rulings

- PUCT Docket 36779—Provides EUL for HVAC equipment.
- PUCT Docket 40885—Provides a petition to revise deemed savings values for Commercial HVAC replacement measures.
- PUCT Docket 41070—Provides energy and demand savings coefficients for an additional climate zone, El Paso, Texas. Prior to this filing, savings for the Dallas-Fort Worth area were used for El Paso, but Dallas-Fort Worth has a colder winter, somewhat more moderate summer, more sunshine, and less precipitation than El Paso.

Relevant Standards and Reference Sources

- ANSI/ASHRAE/IES Standard 90.1-2013. Energy Standard for Buildings Except Low-Rise Residential Buildings. Table 6.8.1-9 through Table 6.8.1-10.
- Code of Federal Regulations. Title 10. Part 431—Energy Efficiency Program for Certain Commercial and Industrial Equipment. <https://www.govinfo.gov/app/details/CFR-2013-title10-vol3/CFR-2013-title10-vol3-part431>.
- ANSI/AHRI Standard 1230, 2010 Standard for Performance Rating of Variable Refrigerant Flow (VRF) Multi-Split Air-Conditioning and Heat Pump Equipment, http://www.ahrinet.org/App_Content/ahri/files/STANDARDS/ANSI/ANSI_AHRI_Standard_1230_2010_with_Add_2.pdf

Document Revision History

Table 13: M&V Variable Refrigerant Systems Revision History

TRM Version	Date	Description of Change
v5.0	10/10/2017	TRM v5.0 origin.
v6.0	10/2018	Minor formula corrections.
v7.0	10/2019	No revisions.

2.2 M&V: WHOLE HOUSE

2.2.1 Residential New Construction Measure Overview

TRM Measure ID: R-HS-NH

Market Sector: Residential

Measure Category: Whole house

Applicable Building Types: Single-family; manufactured

Fuels Affected: Electricity and gas

Decision/Action Types: New construction (NC)

Program Delivery Type: Custom

Deemed Savings Type: For this measure, savings are not deemed and are estimated based on each house's specific characteristics and parameters.

Savings Methodology: EM&V and whole-house simulation modeling

This M&V protocol details the savings estimate for residential new construction projects. The protocol may be applied to the construction of single-family detached homes, multifamily buildings, or individual units within new multifamily buildings. The residential new construction M&V methodology creates a framework to provide high quality verified savings while not restricting the ability of residential new construction program implementers to use the tools and systems they have developed. The protocol allows for flexibility in implementation while developing verified energy savings and balancing the risk associated with uncertainty in the expected savings. The M&V methodology supports the following M&V goals for the new multifamily buildings programs:

- Improve reliability of savings estimates
- Determine whether energy and peak demand savings goals have been met
- Inform future program planning processes.

Streamlined measurement and verification of residential new construction shall leverage a model-based approach to determine energy savings for each home and adhere to typical IPMVP protocols. Modeling software new to the Texas new multifamily building market must be vetted through the EM&V team. Current software approved by the EM&V team include:

- BeOpt¹²
- RESNET accredited software
- Hourly analysis programs tested in accordance with ASHRAE 140 and meeting the requirements of ASHRAE 90.1 Appendix G (i.e., DOE-2, EnergyPlus, HAP, TRACE, IESVS, etc.)¹³

¹² Applicable for the modeling of individual multifamily dwelling units.

¹³ Applicable for the modeling of multifamily buildings or portions thereof.

Additionally, implementers are permitted to use spreadsheets and algorithms that enhance the underlying modeling software as part of a larger modeling package. Such enhancements to modeling packages must also be approved by the EM&V team. Updates to the underlying models or model enhancements shall be reviewed by the EM&V team prior to acceptance of subsequent savings stemming from those changes. Documentation shall be provided by the implementer with features considered trade secret subject to approval by the EM&V team, though kept confidential.

Residential new construction projects participating in energy efficiency programs in Texas should be designed and built to standards well above those applied to standard residential new construction projects in the Texas market. A new energy-efficient Texas multifamily building should have undergone a process of inspections, testing, and verification that meet strict program requirements.

Measure Description

The Residential New Construction measure promotes a holistic approach to achieve energy-efficient new homes, including a combination of envelope and equipment-based improvements. The energy savings estimates are designed to efficiently estimate electric energy and demand savings attributable to each participating new home.

Eligibility Criteria

This measure does not apply to existing construction: only residential new construction projects completed in a given program year are eligible.¹⁴

This measure is to be applied to multifamily buildings, and portions thereof, based on the Implementation Guidance in Section 4.6 Multifamily Guidance of TRM Volume 1.

Baseline Condition¹⁵

Broadly, baseline conditions for the building system (e.g., envelope materials, fenestration characteristics) are set according to relevant codes and standards. For single-family detached homes and residential multifamily buildings three stories or less, these standards are detailed in the Residential Provisions of IECC 2015. As this protocol requires simulation modeling, the provisions of Section R405—Simulated Performance Alternative—are of particular importance. For larger multifamily buildings, the baseline conditions established herein reference the relevant sections of ASHRAE 90.1-2013 and the Commercial Provisions of IECC 2015. Federal manufacturing standards are reflected in the equipment efficiency requirements for space conditioning and water heating equipment. Additionally, the program requirements of reference programs for this market, such as the Energy Star New Homes, inform some baseline requirements.

Accordingly, baseline parameters and key model input values for new single-family detached homes and residential multifamily buildings three stories or less are detailed in Table 14.

¹⁴ In limited cases, townhomes that are constructed as part of a larger multifamily property may qualify under this measure.

¹⁵ Baseline parameters are subject to change with updates to the relevant energy code.

Baseline parameters and key model input values for new residential multifamily buildings of more than three stories (and portions thereof/units within) are detailed in Table 15.

Exception:¹⁶ Multifamily buildings with 4 or 5 stories above-grade¹⁷ where dwelling units occupy 80% or more of the occupiable square footage of the building may select the most appropriate baseline condition. When evaluating mixed-use buildings for eligibility, exclude commercial/retail space when assessing whether the 80% threshold has been met.

14 and Table 15: When a new statewide energy code is adopted by the State Energy Conservation Office (SECO), the baseline parameters for residential whole-house measures must be updated to reflect this change. Recognizing that it takes time for new energy codes to be locally adopted and enforced, this M&V methodology requires the new code as a baseline for the next program year cycle, but not less than twelve months from the energy code effective date. Effective September 1, 2016, Texas adopted 2015 IECC.¹³ From a TRM perspective, the new construction baseline condition change is effective January 1, 2018.

If a baseline study has been conducted since the adoption of the current statewide code that demonstrates standard practice different than the statewide energy code, the researched baseline may be used as the baseline from which to claim savings for the researched jurisdiction(s) subject to the review and approval of the EM&V team.

If a residential new construction project received a Building Permit prior to January 1, 2018, the 2009 IECC baseline might be used as the baseline from which to claim savings.

Ideally, the relevant energy code will be tracked in the program tracking system. Alternatively, it may be tracked as part of the project documentation made available to evaluators upon request. Changes to baseline conditions from 14 and Table 15 or changes to the implementation of baseline conditions within an approved modeling package is allowable and subject to EM&V team approval.

¹⁶ Exception aligns with ENERGY STAR Certified Homes National Program Requirements.

¹⁷ Any above-grade story with 20% or more occupiable space, including commercial space, shall be counted towards the total number of stories for the purpose of determining eligibility to participate in the program. The definition of an 'above-grade story' is one for which more than half of the gross surface area of the exterior walls is above-grade. All below-grade stories, regardless of type, shall not be included when evaluating eligibility.

14: New SF and MF Construction up to Three Stories—Reference Home Characteristics

Baseline and Dwelling Parameters and Characteristics	Reference Home Specification/Value
Architecture	
Number of stories above grade 1	Same as as-built
Foundation type	Same as as-built
Number of bedrooms	Same as as-built
Total conditioned floor area	Same as as-built
Total conditioned volume	Same as as-built
Wall height per floor	Same as as-built
Window distribution (N, S, E, W)	Same as as-built
Percentage of window to floor area	Same as as-built
Front door orientation	Same as as-built
Aspect ratio (length / width)	Same as as-built
Envelope	
Slab R-value and depth	See IECC 2015 Table R402.1.2 Insulation and Fenestration Requirements by Component
Floor assembly U-Factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Frame wall assembly U-factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Mass wall assembly U-factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Basement wall assembly U-factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Crawl space wall assembly U-factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Rim joist assembly U-factor	Same as Wall U-Factor
Fenestration U-factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Skylight U-factor	See IECC 2015 Table R402.1.4 Equivalent U-factors
Glazed fenestration SHGC	See IECC 2015 Table R402.1.2 Insulation and Fenestration Requirements by Component
Window overhang	None
interior shading fraction	Same as as-built
Door U-factor	Same as fenestration U-factor
Ceiling Assembly U-factor	Table R402.1.4 equivalent U-factors
Ceiling type	Same as as-built, except when as-built is a sealed attic assembly, then vented attic
Roof radiant barrier	None
Roof solar absorptivity	0.75
Envelope Testing	

Air infiltration	5 ACH ₅₀ in IECC 2015 CZ 2, 3 ACH ₅₀ in IECC 2015 CZ 3-4
HVAC Equipment	
HVAC equipment type	Same as as-built, except where as-built home has electric resistance heat, in which case the reference home shall have an air source heat pump. ¹⁸
HVAC equipment location	Same as as-built, except when as-built location is in a sealed attic, then located in a vented attic
Cooling capacity	Same as as-built
Heating capacity	Same as as-built
Cooling efficiency (SEER)	14
Heating efficiency (AFUE)	80% AFUE
Heating efficiency (HSPF) - heat pump	8.2
Duct location	Exposed in a vented attic
Duct R-value	R-8
Total duct leakage	4 CFM ₂₅ per 100 ft ² of conditioned floor
Thermostat type	Programmable thermostat
Heating setpoint	72°F
Cooling setpoint	75°F
Mechanical ventilation type	Same as as-built
Mechanical ventilation rate	Same as as-built
Mechanical ventilation hours/day	Same as as-built
Mechanical ventilation fan watts	Same as as-built
Water Heating System	
DHW fuel type	Same as as-built
DHW water heater location	Same as as-built, except when as-built location is in a sealed attic, then located in a vented attic
DHW capacity (gallons)	Same as As-Built for storage-type units. Assume a 40-gallon storage water heater when as-built water heater is instantaneous.
DHW energy factor (UEF)	Water heater efficiency based on updates to federal standards (10 CFR Part 430.32 ¹⁹) as of April 16, 2015
DHW pipe insulation	R-3

¹⁸ A baseline study for the market documenting prevalence of electric resistance units going into that segment in given climate zones would be sufficient to override this requirement.

¹⁹ 10 CFR Part 430.32 Energy and water conservation standards and their effective dates. Online. Available: https://www.ecfr.gov/cgi-bin/retrieveECFR?gp=&SID=cf13a6a9929a57e8a7ca3826966e322c&mc=true&n=sp10.3.430.c&r=SUBPART&ty=HTML#se10.3.430_132 Accessed July 2019.

All bath faucets and showers ≤ 2gpm	No
Hot water recirculation system	No
Drain water heat recovery	No
Lighting	
Fluorescent lighting	75% of permanently installed fixtures
LED lighting	None
Appliances	
Refrigerator	Same as as-built
Dishwasher	Same as as-built
Range/oven	Same as as-built
Clothes washer and dryer	Same as as-built
Ceiling fans	Same as as-built

Table 15: New Multifamily Buildings greater than Three Stories—Baseline Characteristics

Baseline and Dwelling Parameters and Characteristics	Baseline Specification/Value
Envelope	
Unit type	Multifamily building
Number of stories above grade 1	Same as as-built
Foundation type	Same as as-built
Number of bedrooms	Same as as-built
Total conditioned floor area	Same as as-built
Total conditioned volume	Same as as-built
Wall height per floor	Same as as-built
Window distribution (N,S,E,W)	Same as as-built
Percentage of window to floor area	Same as as-built
Front door orientation	Same as as-built
Aspect ratio (length / width)	Use the same estimated average aspect ratio for both baseline and as-built. However, it is recommended to use the actual aspect ratio when actual house footprint dimensions are available.
Roof solar absorptivity	Same as as-built. When as-built data is not available, use 0.75.
Attic insulation U-value	See ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone
Cathedral ceiling insulation U-value	See ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone

Baseline and Dwelling Parameters and Characteristics	Baseline Specification/Value
Percentage cathedral ceilings	Same as as-built
Wall construction	2x4 light gauge metal framing – 16 inch on center spacing
Wall framing fraction	23%
Wall insulation	See ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone
Door R-value	Same as as-built.
Floor insulation	ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone
Rim joist	Same as wall insulation
Window U factor	See ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone
Window SHGC	See ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone
Air infiltration	Same as proposed
Mechanical ventilation	See ASHRAE 90.1-2013, Appendix G
Slab edge insulation	See ASHRAE 90.1-2013, Tables 5.5-1 through 5.5-8, based on climate zone
HVAC Equipment	
HVAC equipment type	See ASHRAE 90.1-2013, Table G3.1.1A/G3.1.1B
Cooling capacity	Same as as-built or simulated to reflect reference home load, not to exceed 20% difference
Heating capacity	Same as as-built or simulated to reflect reference home load, not to exceed 20% difference
Cooling efficiency	See ASHRAE 90.1-2013, Section 6.8
Heating efficiency	See ASHRAE 90.1-2013, Section 6.8
Thermostat type	Same as as-built
Heating setpoint (occupied/unoccupied)	70°F/70°F
Cooling setpoint (occupied/unoccupied)	78°F/80°F
Water Heating System	
DHW fuel type	Same as as-built
DHW capacity (gallons)	Same as as-built for storage. Assume a 50-gallon storage water heater when as-built water heater is instantaneous.
Energy factor (EF)	See ASHRAE 90.1-2013, Table 7.8
DHW temperature	120°F
DHW pipe insulation	None
Low-flow showerheads	None

Baseline and Dwelling Parameters and Characteristics	Baseline Specification/Value
Lighting	
High efficacy lamps	0.51 Watts per ft ²

High-efficiency Condition

The high-efficiency conditions are according to the as-built building's parameters and characteristics.

Energy and Demand Savings Methodology

Savings Algorithms and Input Variables

House Simulation Modeling

Two simulation models should be developed for each residential new construction project or multifamily dwelling unit of building, as appropriate, using an appropriate modeling package software. The first model simulates the baseline home's annual energy use and demand, while the second simulates the as-built home. The energy and demand savings are the difference in annual energy use between the as-built dwelling unit or building and the baseline dwelling unit or building.

Energy Savings Methodology

Energy savings are estimated using whole-building simulation modeling based on on-site specific data collection, such as those data collected by HERS raters.

Summer Demand Savings Methodology

Summer peak demand savings are estimated using whole-building simulation modeling based on on-site data collection and load shape profiles for the specific climate zone.

Winter Demand Savings Methodology

Winter peak demand savings are estimated using whole-building simulation modeling based on on-site data collection and load shape profiles for the specific climate zone.

Post-Processing for Calculating Demand and Energy Savings

Annual energy savings should be calculated as the difference between the simulated annual energy use of the baseline and as-built building for all energy end uses for each dwelling unit or building. Electricity consumption and savings shall be expressed in kilowatt-hours (kWh).

Peak demand savings should be extracted from the hourly data file in a manner consistent with the definition of peak demand incorporated in the TRM and the associated methods for extracting peak demand savings from models producing 8,760 hourly savings using Typical Meteorological Year (TMY) data. Peak demand savings shall be expressed in kilowatts (kW).

Deemed Energy and Demand Savings Tables

This section is not applicable.

Claimed Peak Demand Savings

Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Additional Calculators and Tools

EM&V team approved residential modeling package software should be used to simulate the baseline and as-built home's annual energy use and demand.

Measure Life and Lifetime Savings

The estimated useful life (EUL) of a new home measure is established at 23.0 years

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified and tracked to inform the evaluation and apply the savings properly. While they do not need to be tracked in the program database, they must be in a format easily made available to evaluators.

- Date of issuance of building permit
- Statewide energy code under which the building was built
- Building envelope
 - Dwelling unit type
 - House footprint dimensions
 - Number of stories above grade 1
 - Foundation type
 - Number of bedrooms
 - Total conditioned floor area
 - Total conditioned volume
 - Wall height per floor
 - Window distribution (N, S, E, W)
 - Front door orientation
 - Aspect ratio (length / width)—when available
 - Roof solar absorptivity—when available
 - Attic insulation R-value
 - Cathedral ceiling insulation R-value
 - Percentage cathedral ceilings

- Ceiling insulation grade
- Wall construction
- Wall framing fraction
- Wall insulation (R-value)
- Wall insulation grade
- Door material (wood, metal, vinyl, and whether solid core or hollow)—when available
- Rim joist
- Window U-factor
- Window SHGC
- Air infiltration
- Mechanical ventilation
- Slab edge insulation—only for houses located in IECC climate zone 4
- HVAC equipment
 - HVAC equipment type
 - AHRI number of installed HVAC equipment—in the absence of an AHRI number, manufacturers' cut sheets and/or make and model numbers should be provided instead.
 - Cooling capacity
 - Heating capacity
 - Cooling efficiency (SEER)
 - Heating efficiency (AFUE), and HSPF for heat pumps
 - duct location
 - Duct insulation R-value
 - Duct leakage to outside (CFA)
 - Heating set-point temperature(s) (°F)
 - Cooling set-point temperature(s) (°F)
 - Thermostat type (setback or no setback)
 - Supply fan power (W/CFM)
- Water heating system
 - Water heating systems
 - AHRI number of installed water heating equipment—raters should verify the energy factor (EF) on-site during the final inspection; as part of the implementer QA/QC protocol, verify the AHRI information
 - DHW fuel type
 - DHW capacity (gallons)

- Energy factor
- DHW set-point temperature
- DHW pipe insulation
- Number of low-flow showerheads and flow rate
- Number of low-flow faucets and flow rate
- Lighting
 - Number of sockets with high efficacy lamps or lighting power density, as appropriate.
- Appliances
 - Number of ceiling fans
 - Refrigerator model number
 - Dishwasher model number
 - Clothes washer presence
 - Clothes washer model number

Files to Submit for EM&V Review

The following files should be provided to the utility from which the project sponsor seeks to obtain an incentive for each new home completed:

- Reports of QA/QC or M&V
- Documentation for how the as-built home compares to the base home and modeling and energy savings information
- Relevant modeling files from the approved modeling package
- All input data used to support the modeled energy and peak demand savings, subject to EM&V team approval as part of modeling package approval
- Output results describing energy and peak demand savings, subject to EM&V team approval as part of modeling package approval
- Savings calculations and/or calculators that perform energy savings calculation outside the model

References and Efficiency Standards

RESNET accredited software:

http://www.resnet.us/professional/programs/energy_rating_software

ASHRAE 90.1, *Energy Standard for Buildings Except Low-rise Residential Buildings*

ASHRAE 140, Standard Method of Test for the Evaluation of Building Energy Analysis Programs

ENERGY STAR Multifamily High Rise Program Simulation Guidelines

International Code Council, *2015 International Energy Conservation Code*.

Petitions and Rulings

Not applicable.

Relevant Standards and Reference Sources

Not applicable.

Document Revision History

Table 16: M&V New Construction Revision History

TRM Version	Date	Description of Change
v1.0	11/25/2013	TRM v1.0 origin.
v2.0	4/18/2014	Updated baseline conditions due to federal standard updates for HVAC and water heating equipment. Modified program tracking requirements and requirements surrounding the relevant baseline code.
v2.1	1/30/2015	No revisions.
v3.0	3/13/2015	No revisions.
v3.1	11/05/2015	Moved this measure from TRM Volume 2 to TRM Volume 4. Major measure and methodology updates include the addition of lighting and appliances to the baseline conditions, addressing post-processing calculations, and adding a list of files (including modeling) for projects to submit for EM&V review. Revised and/or added detail regarding Measure Overview, Baseline Condition, Baseline Characteristics, Energy and Demand Savings Methodology, Program Tracking Data and Evaluation Requirements, References and Efficiency Standards, and Document Revision History.
v4.0	10/10/2016	Noted effective date of the new IECC baseline.
v5.0	10/10/2017	Added provision for Multi-Family New Construction.
v6.0	10/2018	No revisions.
v7.0	10/2019	Added provision for multi-family new construction, updated baseline to reflect the adoption of IECC2015

2.3 M&V: RENEWABLES

2.3.1 Nonresidential Solar Photovoltaics (PV) Measure Overview

TRM Measure ID: NR-RN-PV

Market Sector: Commercial

Measure Category: Renewables

Applicable Building Types: All

Fuels Affected: Electricity

Decision/Action Type: N/A

Program Delivery Type: Prescriptive

Deemed Savings Type: Simulation software (kWh), deemed values (kW)

Savings Methodology: Model-calculator (PVWatts®)

Measure Description

This section summarizes the savings calculations of the Solar Photovoltaic standard offer, market transformation, and pilot programs. These programs are offered by the Texas utilities, with the primary objective to achieve cost-effective energy and peak demand savings. Participation in the Solar Photovoltaic program involves the installation of a solar photovoltaic system. The method uses a simulation tool, the National Renewable Energy Laboratory's (NREL) PVWatts® Calculator²⁰ to calculate energy savings. Lookup tables are used to determine deemed summer and winter peak demand savings.

Eligibility Criteria

Only photovoltaic systems that result in reductions of the customer's purchased energy and/or peak demand qualify for savings. Off-grid systems are not eligible. Each utility may have additional incentive program eligibility and interconnection requirements, which are not listed here.

Baseline Condition

PV system not currently installed (typical) or an existing system is present, but additional capacity (including both panels and inverters) may be added.

High-efficiency Condition

Not applicable.

²⁰ See <http://pvwatts.nrel.gov/> last accessed January 20, 2016.

Energy and Demand Savings Methodology

All solar PV systems shall be modeled using the current version of the National Renewable Energy Laboratory's (NREL) PVWatts® calculator. Energy savings are estimated using the default weather data source (currently TMY2) offered by PVWatts®.²¹ Demand savings utilize deemed savings lookup tables with values derived from PVWatts® using TMY3 weather data sources applicable to defined weather zones; an alternative method is also available for commercial systems.

Savings Algorithms and Input Variables

All Installations

PVWatts® input variables (for each array, where an array is defined as a set of PV modules with less than 5 degrees difference in tilt or azimuth):

- Installation ZIP code: use the 5-digit ZIP code of the installation address.
- Weather data file: accept the default (currently TMY2) weather data source offered by PVWatts®.
- DC system size (kW): input the sum of the DC (direct current) power rating of all photovoltaic modules in the array at standard test conditions (STC) in kilowatts DC.
 - For AC modules, refer to the module specification sheet to obtain the DC(STC) power rating.
- Module type: standard, premium, or thin film. Use the nominal module efficiency, cell material, and temperature coefficient from the module datasheet to choose the module type, or accept the default provided by PVWatts®.

Table 17: Module Type Options

Type	Approximate Efficiency	Module Cover	Temperature Coefficient of Power
Standard (crystalline silicon)	15%	Glass	-0.47 %/°C
Premium (crystalline silicon)	19%	Anti-reflective	-0.35 %/°C
Thin film	10%	Glass	-0.20 %/°C

- Array Type: fixed (open rack), fixed (roof mount), 1-axis tracking, 1-axis backtracking, 2-axis tracking
- Tilt (deg): enter the angle from horizontal of the photovoltaic modules in the array
- Azimuth (deg): enter the angle clockwise from true north describing the direction that the array faces

²¹ Applying the PVWatts® default weather input file simplifies estimating and promotes consistency between customers/contractors, program implementers, and evaluators. If or when NREL updates the PVWatts® default to TMY3, the TRM method will follow in the subsequent year, but during the year of the change will continue to rely on TMY2 for consistency. NREL has stated that TMY2 will be “the standard for the foreseeable future.” See <http://pvwatts.nrel.gov/pvwatts.php>, accessed January 25, 2016.

- All other input variables: Accept the PVWatts® default values

Annual Energy Savings (kWh)

Given the inputs above, PVWatts® calculates the estimated annual energy savings for each array.

For systems with multiple arrays, users should derive annual energy savings for each array separately and sum them to obtain the total annual energy savings.

A screenshot (or other save) of the Results page, displaying both the annual energy production and model inputs, is typically required in PV incentive applications and suffices as documentation of the annual energy savings estimate.

Example: A commercial customer in McAllen (zip code 78501) installs a 50 kW_{dc} fixed array comprised of standard crystalline Silicon modules on their rooftop with a tilt of 5 degrees and an azimuth of 175 degrees.

Step 1. The user enters the zip code of the proposed PV system in PVWatts® calculator and presses “Go.” See Figure 1.

Figure 1. PVWatts® Input Screen for Step 1

PVWatts® Calculator

Get Started: [GO](#) [HELP](#) [FEEDBACK](#) [ALL NREL SOLAR TOOLS](#)

NREL's PVWatts® Calculator

Estimates the energy production and cost of energy of grid-connected photovoltaic (PV) energy systems throughout the world. It allows homeowners, small building owners, installers and manufacturers to easily develop estimates of the performance of potential PV installations.

[What's New](#)

[Follow @PVWatts](#)

[f](#) [t](#) [in](#) [+](#) 982

NREL is a national laboratory of the U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy, operated by the Alliance for Sustainable Energy, LLC.

PVWatts® is a registered trademark by Alliance for Sustainable Energy, LLC in Golden, CO, 80401.

[Need Help?](#) | [Security & Privacy](#) | [Disclaimer](#) | [NREL Home](#)

Step 2. PVWatts® automatically identifies the nearest weather data source (currently TMY2). The user does not change the default weather data source and presses “Go to system info.” See Figure 2.

Figure 2. PVWatts® Input Screen for Step 2

The screenshot shows the PVWatts Calculator interface. At the top, there's a header with "PVWatts® Calculator" on the left and the NREL logo on the right. Below the header is a navigation bar with "My Location" (78501, with a "Change Location" link), "HELP", "FEEDBACK", and a dropdown for "ALL NREL SOLAR TOOLS". The main content area has three tabs: "RESOURCE DATA", "SYSTEM INFO", and "RESULTS". The "RESOURCE DATA" tab is active, showing "SOLAR RESOURCE DATA" in large orange letters. Below this, a text box explains that the recommended weather data source is initially listed below. A box labeled "Selected weather data for your location" shows "(TMY2) BROWNSVILLE, TX" and "54 mi". On the right side of the main content area, there is a large orange arrow pointing right with the text "Go to system info" below it.

Step 3. The user enters system info as follows:

- DC system size (kW): 50.00
- Module type: Standard
- Array type: Fixed (roof mount)
- Tilt (deg): 5
- Azimuth (deg): 175

All other details (System Losses, Advanced Parameters, Initial Economics) are left at default values. Once entered, the user presses “Go to PVWatts® results.” See Figure 3.

Figure 3. PVWatts® Input Screen for Step 3

PVWatts® Calculator NREL
NATIONAL RENEWABLE ENERGY LABORATORY

My Location: **78501** [» Change Location](#) HELP FEEDBACK ALL NREL SOLAR TOOLS

RESOURCE DATA **SYSTEM INFO** RESULTS

Go to
resource
data

SYSTEM INFO

Modify the inputs below to run the simulation.

DC System Size (kW):

Module Type:

Array Type:

System Losses (%):

Tilt (deg):

Azimuth (deg):

+ Advanced Parameters

RESTORE DEFAULTS


Draw Your System

Click below to customize your system on a map. (optional)

Go to
PVWatts®
results

Step 4. PVWatts® returns an estimate of annual energy production (kWh), in this case 68,022 kWh. See Figure 4.

Figure 4. PVWatts® Output Screen for Step 4

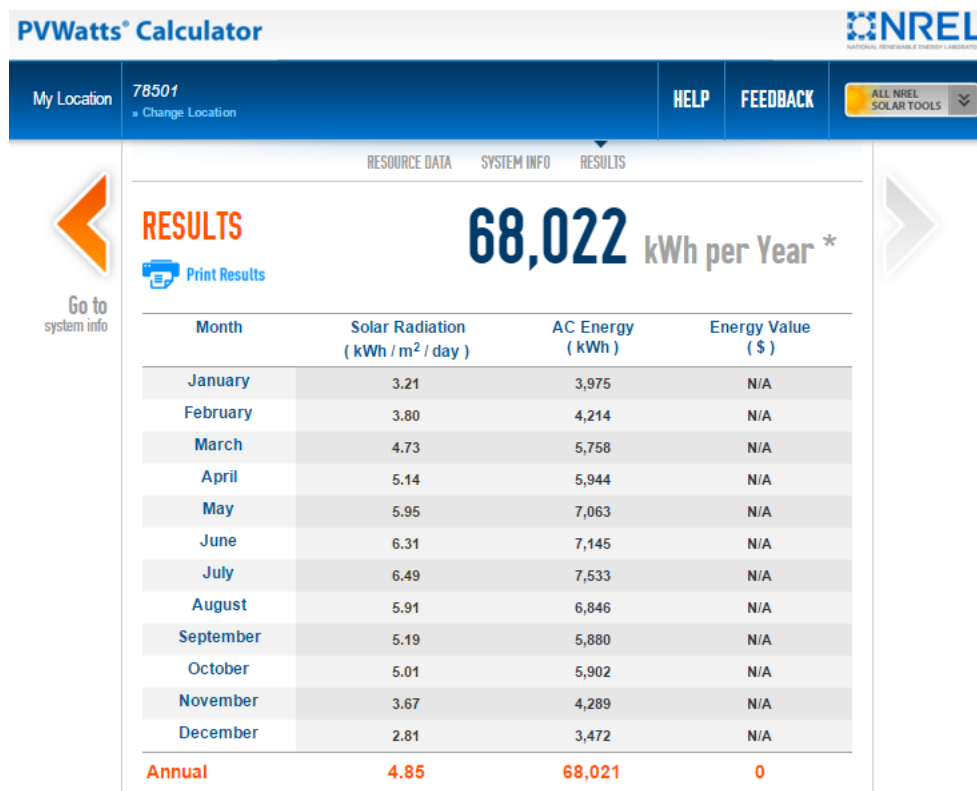

Further down this output page, PVWatts® returns a summary of model inputs (Figure 5).

Figure 5. PVWatts® Output Screen for Step 4 (continued)

Location and Station Identification		
Requested Location	78501	
Weather Data Source	(TMY2) BROWNSVILLE, TX	54 mi
Latitude	25.9° N	
Longitude	97.43° W	
PV System Specifications <i>(Residential)</i>		
DC System Size	50 kW	
Module Type	Standard	
Array Type	Fixed (open rack)	
Array Tilt	5°	
Array Azimuth	175°	
System Losses	14%	
Inverter Efficiency	96%	
DC to AC Size Ratio	1.1	
Initial Economic Comparison		
Average Cost of Electricity Purchased from Utility	No utility data available	
Initial Cost	3.30 \$/Wdc	
Cost of Electricity Generated by System	not determined	

The coordinates (latitude and longitude) of the proposed system are also presented. These are useful to determine the appropriate weather zone to use when estimating demand savings.

A screenshot (or .pdf) of the complete output page, displaying both the annual energy production and model inputs, is typically required in PV incentive applications and suffices as documentation of the annual energy savings estimate.

Summer Demand Savings Methodology

Deemed summer demand savings are determined using the weather zone map (Figure 6) and summer demand savings lookup values (Table 18) provided below. Deemed summer demand savings is the product of the system's DC system size and the appropriate lookup table value.

Deemed Summer Demand Savings

$$\text{Deemed summer demand savings} = \text{DC system size (kW)} * \text{Lookup Value}$$

Equation 47

For systems with multiple arrays, users should derive summer demand savings for each array separately and sum them to obtain the total summer demand savings.

Commercial systems may instead be modeled using the alternative method described below.

Winter Demand Savings Methodology

Deemed winter demand savings are determined using the weather zone map (Figure 6) and winter demand savings lookup values tables (Table 18 through Table 27) provided below. Deemed winter demand savings is the product of the system's DC system size and the appropriate lookup table value.

Deemed Winter Demand Savings

$$\text{Deemed winter demand savings} = \text{DC system size (kW)} * \text{Lookup Value}$$

Equation 48

For systems with multiple arrays, users should derive winter demand savings for each array separately and sum them to obtain the total winter demand savings.

Commercial systems may instead be modeled using the alternative method described below.

Deemed Energy Savings Tables


Not applicable.

Deemed Summer and Winter Demand Savings—Weather Zone Determination

The appropriate weather zone for each system can be determined by identifying the system's coordinates on the map in Figure 6, below. The map identifies weather zones and the reference

TMY3 weather station name and six-digit identifier used in calculating the lookup values within each weather zone. An example of how to use the weather zone map and tables to derive summer and winter peak demand savings is provided below the tables.

Figure 6. Weather Zone Determination for Solar PV Systems

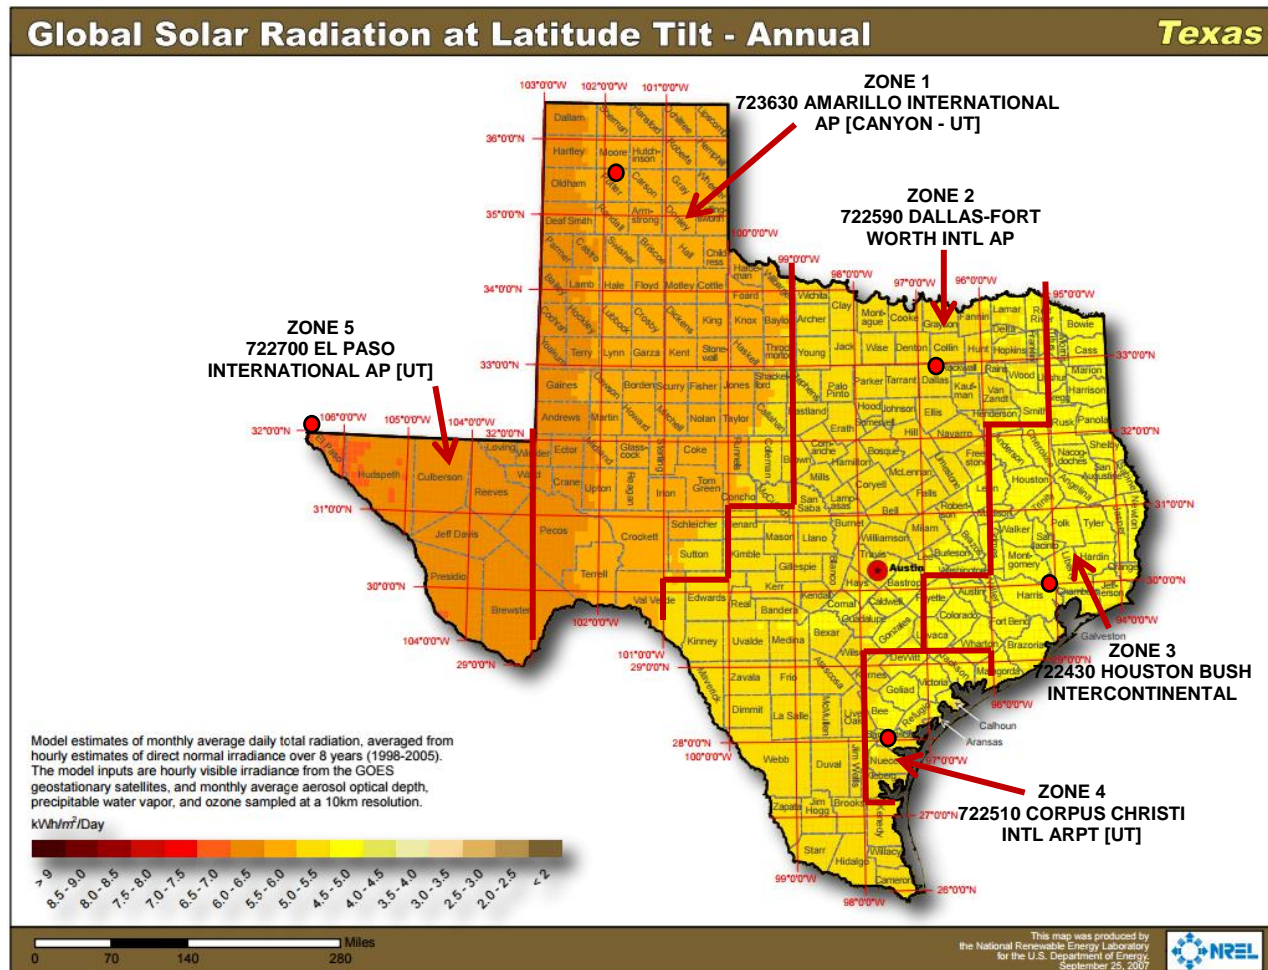

Source: http://apps1.eere.energy.gov/states/images/maps/map_large_pv_TX.jpg, accessed January 20, 2016.

Deemed Summer and Winter Demand Savings—Lookup Value Tables

The tables below provide lookup values used for calculating deemed summer and winter demand savings based on the weather zone, tilt and azimuth. Table 18 through Table 27 present lookup values for determining deemed summer and winter demand savings given various array tilt/azimuth combinations. The values in the tables express summer and winter peak demand savings as a percentage of an array's DC rating at standard test conditions (STC).

Table 18. Climate Zone 1 Amarillo - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	48%	48%	48%	48%	48%
15	>7.5-22.5	35%	40%	49%	56%	58%
30	>22.5-37.5	20%	30%	47%	60%	64%
45	>37.5-52.5	10%	18%	42%	61%	66%
60	>52.5-67.5	7%	10%	34%	59%	65%

Table 19. Climate Zone 1 Amarillo - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	1%	1%	1%	1%	1%
15	>7.5-22.5	3%	3%	2%	1%	0%
30	>22.5-37.5	4%	5%	3%	1%	0%
45	>37.5-52.5	6%	6%	4%	1%	0%
60	>52.5-67.5	6%	7%	4%	0%	0%

Table 20. Climate Zone 2 Dallas - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	46%	46%	46%	46%	46%
15	>7.5-22.5	35%	39%	46%	52%	54%
30	>22.5-37.5	22%	29%	43%	55%	59%
45	>37.5-52.5	12%	19%	38%	56%	60%
60	>52.5-67.5	8%	12%	31%	53%	58%

Table 21. Climate Zone 2 Dallas - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	3%	3%	3%	3%	3%
15	>7.5-22.5	5%	6%	4%	2%	1%
30	>22.5-37.5	8%	8%	5%	2%	1%
45	>37.5-52.5	9%	10%	6%	1%	1%
60	>52.5-67.5	10%	11%	6%	1%	1%

Table 22. Climate Zone 3 Houston - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	36%	36%	36%	36%	36%
15	>7.5-22.5	26%	29%	36%	42%	44%
30	>22.5-37.5	16%	21%	34%	45%	49%
45	>37.5-52.5	9%	14%	29%	46%	51%
60	>52.5-67.5	8%	9%	23%	44%	51%

Table 23. Climate Zone 3 Houston - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	6%	6%	6%	6%	6%
15	>7.5-22.5	10%	11%	8%	5%	3%
30	>22.5-37.5	14%	15%	10%	4%	1%
45	>37.5-52.5	17%	18%	11%	3%	1%
60	>52.5-67.5	18%	19%	12%	2%	1%

Table 24. Climate Zone 4 Corpus Christi - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	41%	41%	41%	41%	41%
15	>7.5-22.5	30%	33%	41%	48%	51%
30	>22.5-37.5	16%	23%	39%	52%	57%
45	>37.5-52.5	8%	14%	34%	53%	60%
60	>52.5-67.5	8%	9%	27%	51%	59%

Table 25. Climate Zone 4 Corpus Christi - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	5%	5%	5%	5%	5%
15	>7.5-22.5	8%	9%	7%	4%	2%
30	>22.5-37.5	11%	12%	8%	3%	1%
45	>37.5-52.5	13%	14%	9%	2%	1%
60	>52.5-67.5	13%	15%	9%	2%	1%

Table 26. Climate Zone 5 El Paso - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	49%	49%	49%	49%	49%
15	>7.5-22.5	40%	44%	49%	54%	55%
30	>22.5-37.5	29%	35%	47%	56%	58%
45	>37.5-52.5	16%	25%	42%	55%	58%
60	>52.5-67.5	10%	15%	34%	51%	55%

Table 27. Climate Zone 5 El Paso - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	0%	0%	0%	0%	0%
15	>7.5-22.5	0%	0%	0%	0%	0%
30	>22.5-37.5	0%	0%	0%	0%	0%
45	>37.5-52.5	0%	0%	0%	0%	0%
60	>52.5-67.5	0%	0%	0%	0%	0%

Deemed Summer and Winter Demand Savings—Example

Example: A commercial customer in McAllen (zip code 78501) installs a 50 kW_{dc} fixed array comprised of standard crystalline Silicon modules on their rooftop with a tilt of 5 degrees and an azimuth of 175 degrees.


Step 1. Determine the appropriate weather zone. Geographic coordinates for this system (25.9°N, 97.43°W) were derived when determining the annual energy savings (kWh). See Figure 7.

Table 28. PVWatts® Output Showing Geographic Coordinates.

Location and Station Identification	
Requested Location	78501
Weather Data Source	(TMY2) BROWNSVILLE, TX 54 mi
Latitude	25.9° N
Longitude	97.43° W

From the weather zone map, this location is in Zone 2. See Figure 7.

Figure 7. Application of the Weather Zone Map.

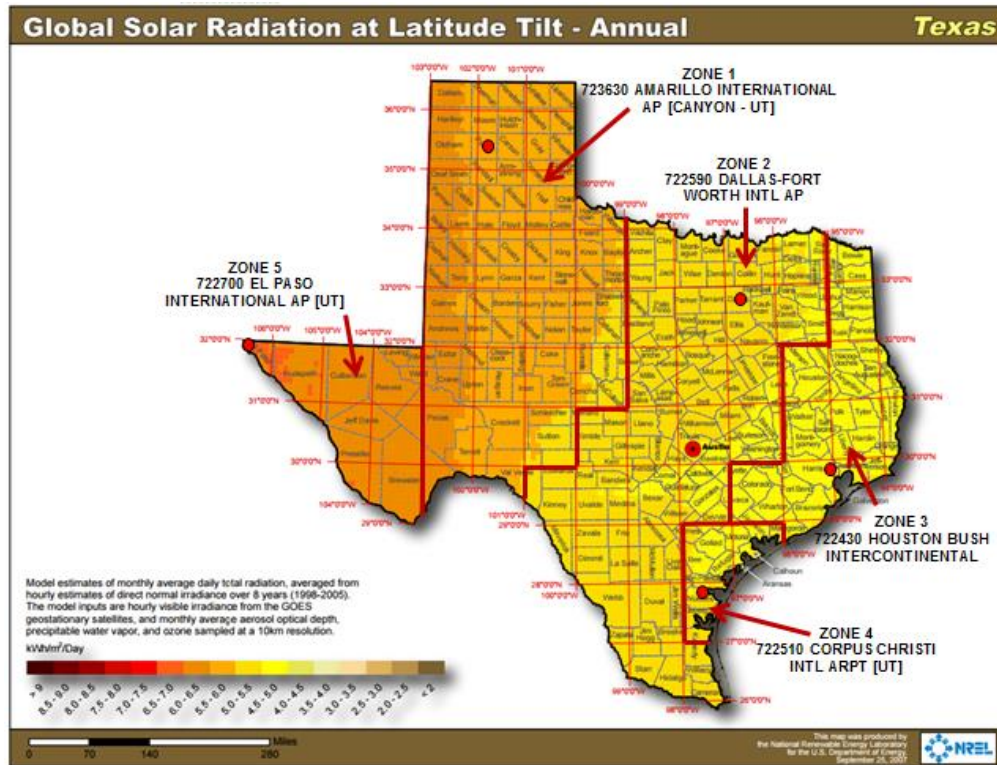

Step 2. Calculate the summer and winter demand savings. From the Zone 2 lookup tables, 5 degree tilt falls within the 0-7.5 degree tilt range, and 175 degree azimuth falls within the 157.5-202.5 azimuth range. The summer lookup value is 46%, and the winter lookup value is 3%.

Applying Equation 47,

$$\text{Deemed summer demand} = \text{DC system size (kW)} * \text{Lookup Value}$$

$$\text{Deemed summer demand} = 50.000 \text{ kW} * 46\%$$

$$\text{Deemed summer demand} = 50.000 \text{ kW} * 0.46$$

$$\text{Deemed summer demand} = 23.000 \text{ kW}$$

Applying Equation 48,

$$\text{Deemed winter demand} = \text{DC system size (kW)} * \text{Lookup Value}$$

$$\text{Deemed summer demand} = 50.000 \text{ kW} * 3\%$$

$$\text{Deemed summer demand} = 50.000 \text{ kW} * 0.03$$

$$\text{Deemed summer demand} = 1.500 \text{ kW}$$

Summer and Winter Demand Savings—Alternative Method

An alternative method for estimating summer and winter demand savings is also available. To use the alternative method, follow these steps:

Step 1. Determine the applicable weather zone of the proposed system using Figure 5, above.

Step 2. Use PVWatts® to model the proposed system as described in the Annual Energy Savings (kWh) section above. However, instead of using the zip code/default weather file, select the TMY3 reference location and weather file associated with the applicable weather zone of the proposed system. (For example, a system in McAllen, weather zone 1, would be modeled based on the DALLAS-FORT WORTH INTL AP, TX TMY3 weather file. Leave all other inputs the same.

Step 3. On the PVWatts Results page, select Download Results: Hourly. Save the **pvwatts_hourly.csv** output file to your computer and open it using Microsoft Excel.

Step 4. Open the provided calculation tool **TRM 4.0 PV tool YYYYMMDD_locked.xlsx** (in which the version date is indicated by the YYYYMMDD field) on your computer, and select the Alt. Method Inputs tab.

Step 5. From the PVWatts hourly output file, highlight and copy the output data (A1:K8780). Paste this data to cell M1 on the Alt. Method Inputs tab in **TRM 4.0 PV tool YYYYMMDD_locked.xlsx** (in which the version date is indicated by the YYYYMMDD field).

Step 6. On the Alt. Methods Outputs tab, the tool calculates and displays summer and winter demand savings as AC capacity (kW_{ac}) and as a percentage of the DC capacity of the modeled system.

Claimed Peak Demand Savings

Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Measure Life and Lifetime Savings

The estimated useful life (EUL) of photovoltaic system is established at 30.0 years. This value is consistent with engineering estimates based on manufacturers' warranties and historical data.

Additional Calculators and Tools

TRM 4.0 PV tool YYYYMMDD_locked.xlsx (in which the version date is indicated by the YYYYMMDD field), provided by Frontier Associates, is used to determine summer and winter demand savings. The most current version is posted at the Texas energy efficiency website, <http://www.texasefficiency.com/>. Utilities have the option to create their own versions.

Program Tracking Data and Evaluation Requirements

The following information will be required to be collected to determine the project eligibility.

- Project location (city) and zip code
- Module type: standard, premium, or thin film
- Array Type: fixed (open rack), fixed (roof mount), 1-axis tracking, 1-axis backtracking, 2-axis tracking, etc.
- Tilt, azimuth and DC system size rating for each array
- Date of PVWatts® run, and PVWatts® report (retained with project documentation)

References and Efficiency Standards

Petitions and Rulings

PUCT Docket 36779—Provides estimate for EUL.

Relevant Standards and Reference Sources

National Electric Code (NEC) 690, “Solar Photovoltaic Systems” or local building codes.

P. Dobos. PVWatts® Version 5 Manual. National Renewable Energy Laboratory. NREL/TP-6A20-62641. September 2014. <http://www.nrel.gov/docs/fy14osti/62641.pdf>. PVWatts® calculator available at <http://pvwatts.nrel.gov/pvwatts.php>

Document Revision History

Table 29: M&V Nonresidential Solar PV Revision History

TRM Version	Date	Description of Change
v1.0	11/25/2013	TRM v1.0 origin.
v3.1	11/05/2015	Updated to reflect EPE's 2016 program and revised maximum incentivized size for EPE from 50 to 10 kW.
v4.0	10/10/2016	Removed deemed savings option for energy. Provided new method for calculating summer and winter demand savings and provided deemed summer and winter demand savings lookup tables.
v5.0	10/10/2017	Corrected equation, figure, and table references.
v6.0	10/2018	No revisions.
v7.0	10/2019	No revisions.

2.3.2 Residential Solar Photovoltaics (PV) Measure Overview

TRM Measure ID: R-RN-PV

Market Sector: Residential

Measure Category: Renewables

Applicable Building Types: Single-family, duplex, and triplex; multifamily; manufactured

Fuels Affected: Electricity

Decision/Action Type(s): Retrofit, new construction

Program Delivery Type(s): Prescriptive

Deemed Savings Type: Simulation software (kWh), deemed values (kW)

Savings Methodology: Model-calculator (PVWatts®)

Measure Description

This section summarizes the savings calculations of the Solar Photovoltaic standard offer, market transformation, and pilot programs. The primary objective of these programs is to achieve cost-effective reduction in energy savings and peak demand savings. Participation in the Solar Photovoltaic program involves the installation of a solar photovoltaic system. The method uses a simulation tool, the National Renewable Energy Laboratory's (NREL) PVWatts® Calculator²² to calculate energy savings. Lookup tables are used to determine deemed summer and winter peak demand savings.

Eligibility Criteria

Only photovoltaic systems that result in reductions of the customer's purchased energy and/or peak demand qualify for savings. Off-grid systems are not eligible. Each utility may have additional incentive program eligibility and interconnection requirements, which are not listed here.

Baseline Condition

PV system not currently installed (typical), or an existing system is present but additional capacity (including both panels and inverters) may be added.

High-efficiency Condition

Not applicable.

²² See <http://pvwatts.nrel.gov/>, accessed January 20, 2016.

Energy and Demand Savings Methodology

All solar PV systems shall be modeled using the current version of the National Renewable Energy Laboratory's (NREL) PVWatts® calculator. Energy savings are estimated using the default weather data source (currently TMY2) offered by PVWatts®.²³ Demand savings use deemed savings lookup tables with values derived from PVWatts® using reference TMY3 weather data sources applicable to defined weather zones; an Alternative Method is available for residential systems utilizing trackers or systems for which deemed savings lookup values are not available due to extreme array tilt or azimuth.

Savings Algorithms and Input Variables

All Installations

PVWatts® input variables (for each array, where an array is defined as a set of PV modules with less than 5 degrees difference in tilt or azimuth):

- Installation ZIP code: use the 5-digit ZIP code of the installation address.
- Weather data file: accept the default (currently TMY2) weather data source offered by PVWatts®.
- DC system size (kW): input the sum of the DC (direct current) power rating of all photovoltaic modules in the array at standard test conditions (STC) in kilowatts DC.
 - For AC modules, refer to the module specification sheet to obtain the DC(STC) power rating.
- Module Type: standard, premium, or thin film. Use the nominal module efficiency, cell material, and temperature coefficient from the module data sheet to choose the module type, or accept the default provided by PVWatts®.

Table 30. Module Type Options

Type	Approximate Efficiency	Module Cover	Temperature Coefficient of Power
Standard (crystalline Silicon)	15%	Glass	-0.47 %/°C
Premium (crystalline Silicon)	19%	Anti-reflective	-0.35 %/°C
Thin film	10%	Glass	-0.20 %/°C

- Array type: fixed (open rack), fixed (roof mount), 1-axis tracking, 1-axis backtracking, 2-axis tracking
- Tilt (deg): enter the angle from horizontal of the photovoltaic modules in the array

²³ Applying the PVWatts® default weather input file simplifies estimating and promotes consistency between customers/contractors, program implementers, and evaluators. If or when NREL updates the PVWatts® default to TMY3, the TRM method will follow in the subsequent year, but during the year of the change will continue to rely on TMY2 for consistency. NREL has stated that TMY2 will be “the standard for the foreseeable future.” See <http://pvwatts.nrel.gov/pvwatts.php>, accessed January 25, 2016.

- Azimuth (deg): enter the angle clockwise from true north describing the direction that the array faces
- All other input variables: accept the PVWatts® default values

Annual Energy Savings (kWh)

Given the inputs above, PVWatts® calculates the estimated annual energy savings for each array.

For systems with multiple arrays, users should derive annual energy savings for each array separately and sum them to obtain the total annual energy savings.

A screenshot (or other save) of the Results page, displaying both the annual energy production and model inputs, is typically required in PV incentive applications, and suffices as documentation of the annual energy savings estimate.

Example: A residential customer in Abilene (zip code 79601) installs a 5 kW_{dc} fixed array comprised of standard crystalline silicon modules on their rooftop with a tilt of 15 degrees and an azimuth of 200 degrees.

Step 1. The user enters the zip code of the proposed PV system in PVWatts® calculator and presses “Go.” See Figure 8.

Figure 8. PVWatts® Input Screen for Step 1

PVWatts® Calculator NREL
NATIONAL RENEWABLE ENERGY LABORATORY

Get Started: Go » HELP FEEDBACK ALL NREL SOLAR TOOLS

NREL's PVWatts® Calculator

Estimates the energy production and cost of energy of grid-connected photovoltaic (PV) energy systems throughout the world. It allows homeowners, small building owners, installers and manufacturers to easily develop estimates of the performance of potential PV installations.

[Follow @PVWatts](#)

f
t
in
+
107

NREL is a national laboratory of the U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy, operated by the Alliance for Sustainable Energy, LLC.

PVWatts® is a registered trademark by Alliance for Sustainable Energy, LLC in Golden, CO, 80401.

Need Help? | Security & Privacy | Disclaimer | [NREL Home](#)

Step 2. PVWatts® automatically identifies the nearest weather data source (currently TMY2). The user does not change the default weather data source and presses “Go to system info.” See Figure 9.

Figure 9. PVWatts® Input Screen for Step 2

The screenshot shows the PVWatts Calculator interface. At the top, there's a header with "PVWatts® Calculator" on the left and the NREL logo on the right. Below the header is a navigation bar with "My Location" (79601, with a "Change Location" link), "HELP", "FEEDBACK", and a dropdown for "ALL NREL SOLAR TOOLS". The main content area has three tabs: "RESOURCE DATA" (selected), "SYSTEM INFO", and "RESULTS". The "RESOURCE DATA" section is titled "SOLAR RESOURCE DATA" and includes a note: "The recommended weather data source is initially listed below. This is usually a good choice for your location, but you can optionally change the weather data using the map below." Below this, a box displays "Selected weather data for your location" as "(TMY2) ABILENE, TX" with a distance of "7.1 mi". On the right side of the main content area, there is a large orange arrow pointing right with the text "Go to system info" below it.

Step 3. The user enters system info as follows:

- DC system size (kW): 5.00
- Module type: Standard
- Array type: fixed (roof mount)
- Tilt (deg): 20
- Azimuth (deg): 200

All other details (System Losses, Advanced Parameters, and Initial Economics) are left at default values. Once entered, the user presses “Go to PVWatts® results.” See Figure 10. PVWatts® Input Screen for Step 3.

Figure 10. PVWatts® Input Screen for Step 3

PVWatts® Calculator **NREL**
NATIONAL RENEWABLE ENERGY LABORATORY

My Location: **79601** [Change Location](#) **HELP** **FEEDBACK** **ALL NREL SOLAR TOOLS**

RESOURCE DATA **SYSTEM INFO** RESULTS

Go to resource data

SYSTEM INFO

Modify the inputs below to run the simulation.

DC System Size (kW):

Module Type: Standard

Array Type: Fixed (roof mount)

System Losses (%):

Tilt (deg):

Azimuth (deg):

[+ Advanced Parameters](#)

RESTORE DEFAULTS


Draw Your System

Click below to customize your system on a map. (optional)

Go to PVWatts® results

Step 4. PVWatts® returns an estimate of annual energy production (kWh), in this case 7,850 kWh. See Figure 11.

Figure 11. PVWatts® Output Screen for Step 4

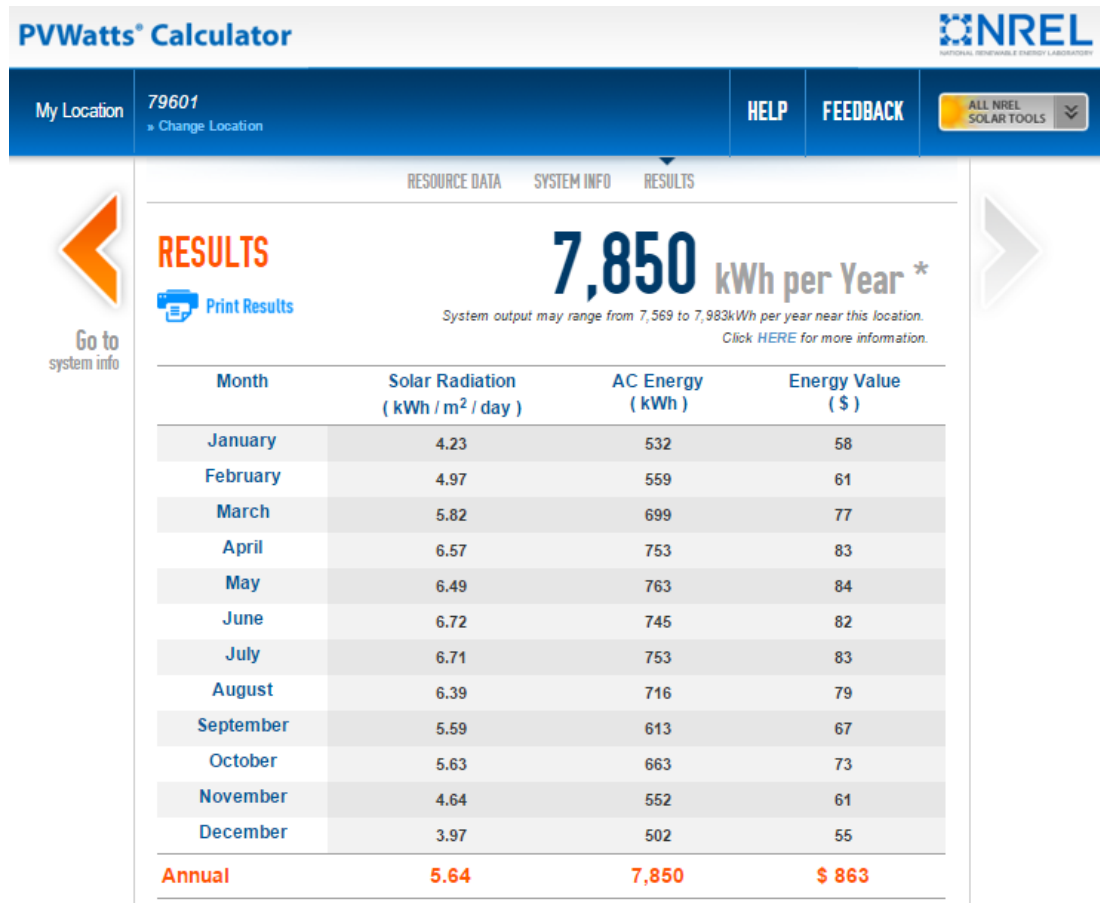

Further down this output page PVWatts® returns a summary of model inputs (Figure 12).

Figure 12. PVWatts® Output Screen for Step 4 (continued).

Location and Station Identification	
Requested Location	79601
Weather Data Source	(TMY2) ABILENE, TX 7.1 mi
Latitude	32.43° N
Longitude	99.68° W
PV System Specifications (Residential)	
DC System Size	5 kW
Module Type	Standard
Array Type	Fixed (roof mount)
Array Tilt	20°
Array Azimuth	200°
System Losses	14%
Inverter Efficiency	96%
DC to AC Size Ratio	1.1
Initial Economic Comparison	
Average Cost of Electricity Purchased from Utility	0.11 \$/kWh
Initial Cost	3.30 \$/Wdc
Cost of Electricity Generated by System	0.17 \$/kWh

The coordinates (latitude and longitude) of the proposed system are also presented. These are useful to determine the appropriate weather zone to use when estimating demand savings.

A screenshot (or PDF) of the complete output page, displaying both the annual energy production and model inputs, is typically required in PV incentive applications, and suffices as documentation of the annual energy savings estimate.

Summer Demand Savings Methodology

Deemed summer demand savings are determined using the weather zone map (Figure 13) and summer demand savings lookup values tables provided below. Deemed summer demand savings is the product of the system's DC system size and the appropriate lookup table value.

Deemed Summer Demand Savings

$$\text{Deemed summer demand savings} = \text{DC system size (kW)} * \text{Lookup Value}$$

Equation 49

For systems with multiple arrays, users should derive summer demand savings for each array separately and sum them to obtain the total summer demand savings.

In rare cases, residential systems using trackers or systems for which deemed savings lookup values are not available due to extreme array tilt or azimuth may use the Alternative Method described below.

Winter Demand Savings Methodology

Deemed winter demand savings are determined using the weather zone map (Figure 13) and winter demand savings lookup values tables (Table 18) provided below. Deemed winter demand savings is the product of the system's DC system size and the appropriate lookup table value.

Deemed Winter Demand Savings

$$\text{Deemed winter demand savings} = \text{DC system size (kW)} * \text{Lookup Value}$$

Equation 50

For systems with multiple arrays, users should derive winter demand savings for each array separately and sum them to obtain the total winter demand savings.

In rare cases, residential systems utilizing trackers or systems for which deemed savings lookup values are not available due to extreme array tilt or azimuth may utilize the Alternative Method described below.


Deemed Energy Savings Tables

Not applicable.

Deemed Summer and Winter Demand Savings—Weather Zone Determination

The appropriate weather zone for each system can be determined by identifying the system's coordinates on the map in Figure 13, below. The figure identifies weather zones and the reference TMY3 weather station name and five-digit identifier used in calculating the lookup values within each weather zone. An example of how to use the weather zone map and tables to derive summer and winter peak demand savings is provided below the tables.

Figure 13. Weather Zone Determination for Solar PV Systems

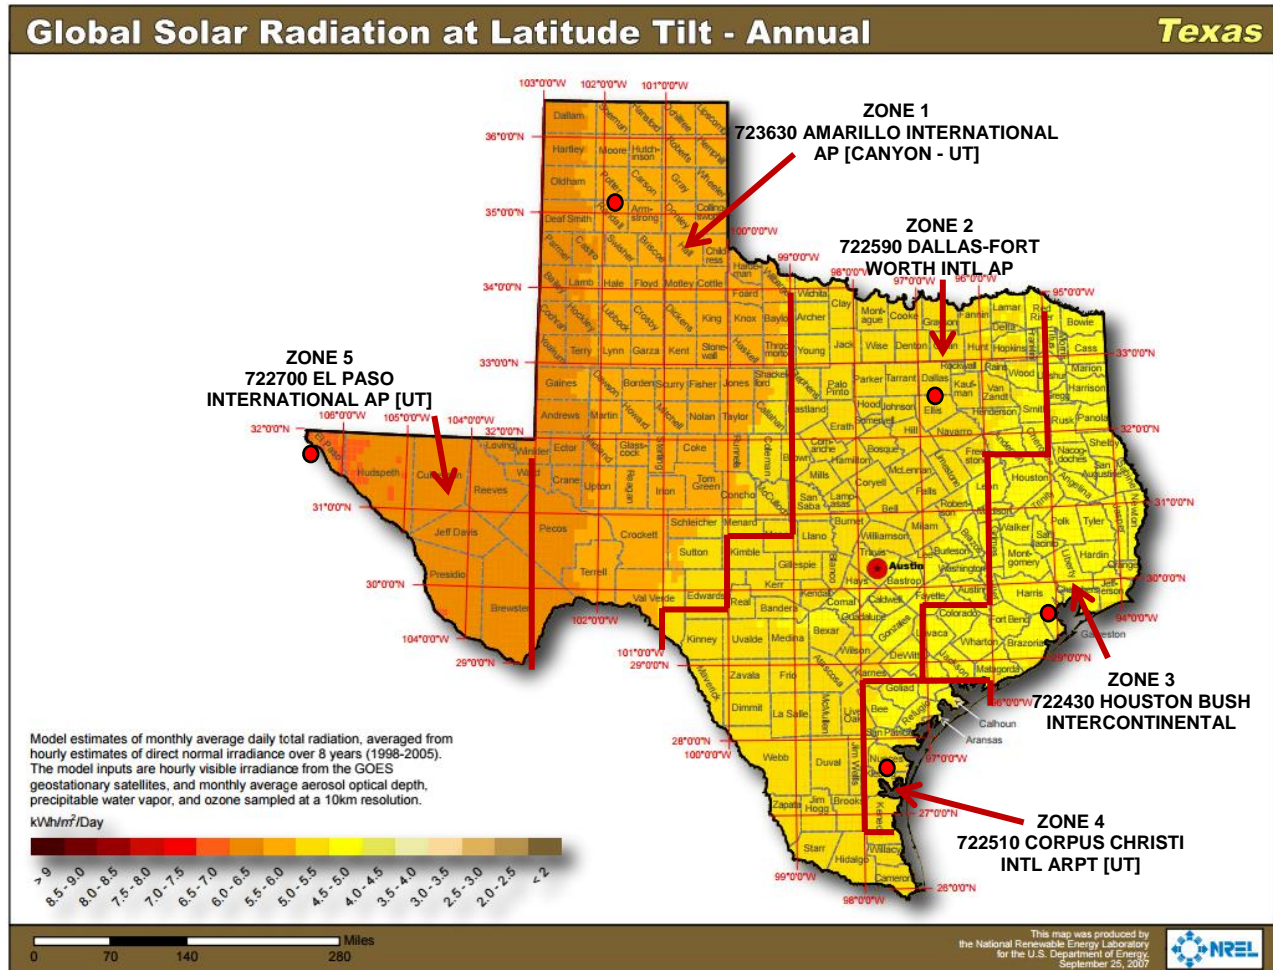

Source: http://apps1.eere.energy.gov/states/images/maps/map_large_pv_TX.jpg, accessed January 20, 2016.

Deemed Summer and Winter Demand Savings—Lookup Value Tables

The tables below provide lookup values used for calculating deemed summer and winter demand savings based on the weather zone, tilt and azimuth. Table 31 through Table 40 present lookup values for determining deemed summer and winter demand savings given various array tilt/azimuth combinations. The values in the tables express summer and winter peak demand savings as a percentage of an array's DC rating at standard test conditions (STC).

Table 31. Climate Zone 1 Amarillo - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	48%	48%	48%	48%	48%
15	>7.5-22.5	35%	40%	49%	56%	58%
30	>22.5-37.5	20%	30%	47%	60%	64%
45	>37.5-52.5	10%	18%	42%	61%	66%
60	>52.5-67.5	7%	10%	34%	59%	65%

Table 32. Climate Zone 1 Amarillo - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	1%	1%	1%	1%	1%
15	>7.5-22.5	3%	3%	2%	1%	0%
30	>22.5-37.5	4%	5%	3%	1%	0%
45	>37.5-52.5	6%	6%	4%	1%	0%
60	>52.5-67.5	6%	7%	4%	0%	0%

Table 33. Climate Zone 2 Dallas - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	46%	46%	46%	46%	46%
15	>7.5-22.5	35%	39%	46%	52%	54%
30	>22.5-37.5	22%	29%	43%	55%	59%
45	>37.5-52.5	12%	19%	38%	56%	60%
60	>52.5-67.5	8%	12%	31%	53%	58%

Table 34. Climate Zone 2 Dallas - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	3%	3%	3%	3%	3%
15	>7.5-22.5	5%	6%	4%	2%	1%
30	>22.5-37.5	8%	8%	5%	2%	1%
45	>37.5-52.5	9%	10%	6%	1%	1%
60	>52.5-67.5	10%	11%	6%	1%	1%

Table 35. Climate Zone 3 Houston - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	36%	36%	36%	36%	36%
15	>7.5-22.5	26%	29%	36%	42%	44%
30	>22.5-37.5	16%	21%	34%	45%	49%
45	>37.5-52.5	9%	14%	29%	46%	51%
60	>52.5-67.5	8%	9%	23%	44%	51%

Table 36. Climate Zone 3 Houston - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	6%	6%	6%	6%	6%
15	>7.5-22.5	10%	11%	8%	5%	3%
30	>22.5-37.5	14%	15%	10%	4%	1%
45	>37.5-52.5	17%	18%	11%	3%	1%
60	>52.5-67.5	18%	19%	12%	2%	1%

Table 37. Climate Zone 4 Corpus Christi - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	41%	41%	41%	41%	41%
15	>7.5-22.5	30%	33%	41%	48%	51%
30	>22.5-37.5	16%	23%	39%	52%	57%
45	>37.5-52.5	8%	14%	34%	53%	60%
60	>52.5-67.5	8%	9%	27%	51%	59%

Table 38. Climate Zone 4 Corpus Christi - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	5%	5%	5%	5%	5%
15	>7.5-22.5	8%	9%	7%	4%	2%
30	>22.5-37.5	11%	12%	8%	3%	1%
45	>37.5-52.5	13%	14%	9%	2%	1%
60	>52.5-67.5	13%	15%	9%	2%	1%

Table 39. Climate Zone 5 El Paso - Summer Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	49%	49%	49%	49%	49%
15	>7.5-22.5	40%	44%	49%	54%	55%
30	>22.5-37.5	29%	35%	47%	56%	58%
45	>37.5-52.5	16%	25%	42%	55%	58%
60	>52.5-67.5	10%	15%	34%	51%	55%

Table 40. Climate Zone 5 El Paso - Winter Demand kW Savings

		Azimuth (Degrees, Center and Range)				
Tilt (Degrees)		90	135	180	225	270
Center	Range	>67.5-112.5	>112.5-157.5	>157.5-202.5	>202.5-247.5	>247.5-292.5
0	0-7.5	0%	0%	0%	0%	0%
15	>7.5-22.5	0%	0%	0%	0%	0%
30	>22.5-37.5	0%	0%	0%	0%	0%
45	>37.5-52.5	0%	0%	0%	0%	0%
60	>52.5-67.5	0%	0%	0%	0%	0%

Deemed Summer and Winter Demand Savings—Example

Example: A residential customer in Abilene (zip code 79601) installs a 5 kW_{dc} fixed array comprised of standard crystalline silicon modules on their rooftop with a tilt of 15 degrees and an azimuth of 200 degrees.


Step 1. Determine the appropriate weather zone. Geographic coordinates for this system (32.43°N, 99.68°W) were derived when determining the annual energy savings (kWh). See Figure 14.

Figure 14. PVWatts® Output Showing Geographic Coordinates.

Location and Station Identification	
Requested Location	79601
Weather Data Source	(TMY2) ABILENE, TX 7.1 mi
Latitude	32.43° N
Longitude	99.68° W

From the weather zone map, this location is in zone 1. See Figure 15. Application of the Weather Zone Map.

Figure 15. Application of the Weather Zone Map

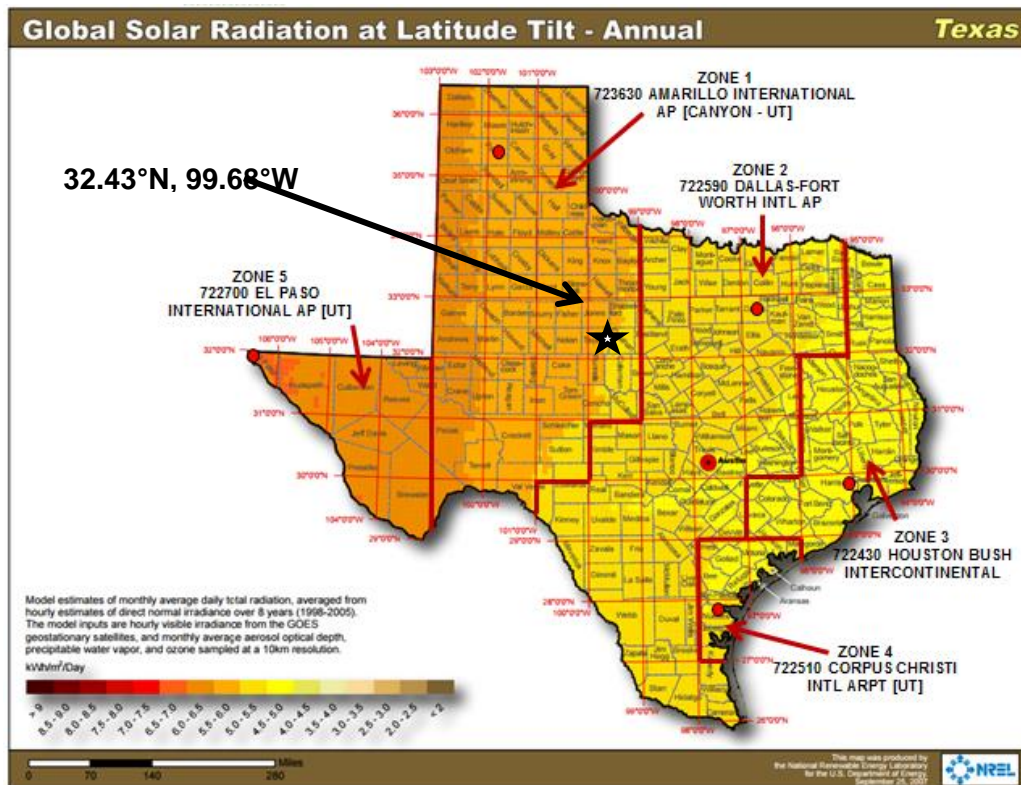

Step 2. Calculate the summer and winter demand savings. From the zone 1 lookup tables, 20-degree tilt falls within the 7.5-22.5 degree tilt range, and 200 degree azimuth falls within the 157.5-202.5 azimuth range. The summer lookup value is 49%, and the winter lookup value is 2%.

Applying Equation 49,

$$\text{Deemed summer demand} = \text{DC system size (kW)} * \text{Lookup Value}$$

$$\text{Deemed summer demand} = 5.000 \text{ kW} * 49\%$$

$$\text{Deemed summer demand} = 5.000 \text{ kW} * 0.49$$

$$\text{Deemed summer demand} = 2.450 \text{ kW}$$

Applying Equation 50

$$\text{Deemed winter demand} = \text{DC system size (kW)} * \text{Lookup Value}$$

$$\text{Deemed summer demand} = 5.000 \text{ kW} * 2\%$$

$$\text{Deemed summer demand} = 5.000 \text{ kW} * 0.02$$

$$\text{Deemed summer demand} = 0.100 \text{ kW}$$

Summer and Winter Demand Savings—Alternative Method

An alternative method for estimating summer and winter demand savings is available to residential systems utilizing trackers or systems for which deemed savings lookup values are not available due to extreme array tilt or azimuth. To utilize the alternative method, follow these steps:

Step 1. Determine the applicable weather zone of the proposed system using Figure 5, above.

Step 2. Use PVWatts® to model the proposed system as described in the Annual Energy Savings (kWh) section above. However, instead of using the zip code/default weather file, select the TMY3 reference location and weather file associated with the applicable weather zone of the proposed system. (For example, a system in Abilene, weather zone 1, would be modeled based on the AMARILLO INTERNATIONAL AP [CANYON-UT], TX TMY3 weather file. Leave all other inputs the same.

Step 3. On the PVWatts Results page, select Download Results: Hourly. Save the **pvwatts_hourly.csv** output file to your computer and open it using Microsoft Excel.

Step 4. Open the provided calculation tool **TRM 4.0 PV tool YYYYMMDD_locked.xlsx** (in which the version date is indicated by the YYYYMMDD field) on your computer, and select the Alt. Method Inputs tab.

Step 5. From the PVWatts hourly output file, highlight and copy the output data (A1:K8780). Paste this data to cell M1 on the Alt. Method Inputs tab in **TRM 4.0 PV tool YYYYMMDD_locked.xlsx** (in which the version date is indicated by the YYYYMMDD field).

Step 6. On the Alt. Methods Outputs tab, the tool calculates and displays summer and winter demand savings as AC capacity (kW_{ac}) and as a percentage of the DC capacity of the modeled system.

Claimed Peak Demand Savings

Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Additional Calculators and Tools

TRM 4.0 PV tool YYYYMMDD_locked.xlsx (in which the version date is indicated by the YYYYMMDD field), provided by Frontier Associates, is used to determine summer and winter demand savings. The most current version is posted at the Texas energy efficiency website, <http://www.texasefficiency.com/>. Utilities have the option to create their own versions.

Measure Life and Lifetime Savings

The estimated useful life (EUL) of photovoltaic systems is established at 30.0 years. This value is consistent with engineering estimates based on manufacturers' warranties and historical data.

Program Tracking Data and Evaluation Requirements

The following information will be required to be collected.

- Project location (city) and zip code
- Module type: standard, premium, or thin film
- Array Type: fixed (open rack), fixed (roof mount), 1-axis tracking, 1-axis backtracking, 2-axis tracking, etc.
- Tilt, azimuth and DC system size rating for each array
- Date of PVWatts® run, and PVWatts® report (retained with project documentation) for each array
- Selected climate zone and demand method used
- For projects using the alternative method, retention of the TRM 4.0 PV tool workbook for each array evaluated

References and Efficiency Standards

Petitions and Rulings

PUCT Docket 36779—Provides estimate for EUL.

Relevant Standards and Reference Sources

- National Electric Code (NEC) 690, “Solar Photovoltaic Systems” or local building codes.
- P. Dobos. PVWatts® Version 5 Manual. National Renewable Energy Laboratory. NREL/TP-6A20-62641. September 2014. <http://www.nrel.gov/docs/fy14osti/62641.pdf>. PVWatts® calculator available at: <http://pvwatts.nrel.gov/pvwatts.php>.

Document Revision History

Table 41: M&V Residential Solar PV Revision History

TRM Version	Date	Description of Change
v1.0	11/25/2013	TRM v1.0 origin.
v2.0	04/18/2014	Minor edits to language and structure.
v2.1	01/30/2015	No revisions.
v3.0	04/10/2015	No revisions.
v4.0	10/10/2016	Removed deemed savings option for energy. Provided new method for calculating summer and winter demand savings and provided deemed summer and winter demand savings lookup tables.
v5.0	10/10/2017	Corrected equation, figure, and table references.
v6.0	10/2018	No revisions.
v7.0	10/2019	No revisions.

2.3.3 Solar Shingles Measure Overview

TRM Measure ID: R-RN-SS and NR-RN-SS

Market Sector: Residential and commercial

Measure Category: Renewables

Applicable Building Types: All

Fuels Affected: Electricity

Decision/Action Types: Retrofit (RET), new construction (NC)

Program Delivery Type: Custom

Deemed Savings Type: Prescribed simulation software EM&V

Savings Methodology: Software modeling tool and calculator-SAM

Streamlined measurement and verification of solar shingles installations shall consist of the development of a project-specific model of the installed solar shingle system using the System Advisor Model (SAM), developed by the National Renewable Energy Lab (NREL), as specified herein. A solar shingles system consists of all connected arrays and sub-arrays and connected inverter(s).

Measure Description

A solar shingles system consists of all connected arrays and sub-arrays and connected inverter(s). The M&V method used to estimate savings is through a simulation model approach using the National Renewable Energy Laboratory's (NREL) System Advisor Model (SAM). Either version 2015.6.30 or subsequent most recent version of the SAM software shall be used.

Eligibility Criteria

Solar shingle systems consisting of connected arrays, sub-arrays, and inverter(s).

The installation must meet the following requirements to be eligible for incentives:

- Systems shall be installed by a licensed electrical contractor or, in the case of a residential installation by the homeowner, with the approval of the electrical inspector in accordance with the National Electric Code (NEC 690, "Solar Photovoltaic Systems") and/or local building codes.
- If the system is utility interactive the inverter shall be listed and certified by a national testing laboratory authority (e.g., UL 1741, "Static Inverters and Charge Controllers for Use in Photovoltaic Power Systems") as meeting the requirements of the Institute of Electrical and Electronics Engineers (IEEE) Standard 929-2000 "Recommended Practice for Utility Interface of Photovoltaic (PV) Systems."
- The estimated annual energy generation from the solar shingles system shall not exceed the customer's annual energy consumption.

Baseline Condition

PV system not currently installed (typical).

High-efficiency Condition

PV systems must meet the eligibility criteria shown above to be eligible for reporting claimed energy impacts. The high-efficiency conditions are estimated based on appropriate use of NREL's SAM software modeling tool for solar shingle installation analysis.

Energy and Demand Savings Methodology

Not applicable.

Savings Algorithms and Input Variables

SAM solar shingle installation data, modeling and analysis

SAM can be downloaded from the NREL website.²⁴

SAM Data Input

The following steps present the information and sequence required to accurately model solar shingle projects using the SAM software tool.

1. Create a new solar PV project in SAM.
2. Specify a Solar PV project and select a market segment (e.g., residential, commercial).
3. Solar systems are configured in the SAM main model interface that is organized across a number of screens, selected by a topics menu on the left-hand side of the window. The following items must be configured:

Location and Resource. An appropriate weather file must be specified in the subsequent screen. SAM is pre-loaded with a selection of weather files from the NREL NSRDB TMY3 datasets. The user should specify one of the five locations provided in Table 42, according to where in Texas the solar shingles are being installed. The map in Figure 16 indicates the delineation of the weather zones, by county.


NOTE: It is critical that the TMY3 files be specified in the model for estimating peak demand impacts, and that the corresponding set of peak hours and relative probabilities from TRM Volume 1 Section 4 shall be used to estimate peak demand impacts.

²⁴ As of publication of this version, the latest release of SAM is Version 2015.6.30. Instructions provided herein are intended to be sufficiently generic to allow for successful model creation in this and subsequent iterations of the software; however, it is impossible to anticipate the exact nature of future software revisions.

Table 42: TMY Data File by TRM Weather Zone

TRM Weather Zone		TMY3 File	TMY3 Location
1	Panhandle Region	723630	Amarillo Intl AP [Canyon—UT]
2	North Region	722590	Dallas Fort Worth Intl AP
3	South Region	722430	Houston Bush Intercontinental
4	Valley Region	722510	Corpus Christi Intl AP [UT]
5	West Region	722700	El Paso International AP [UT]

Figure 16: Texas Technical Reference Manual Weather Zones

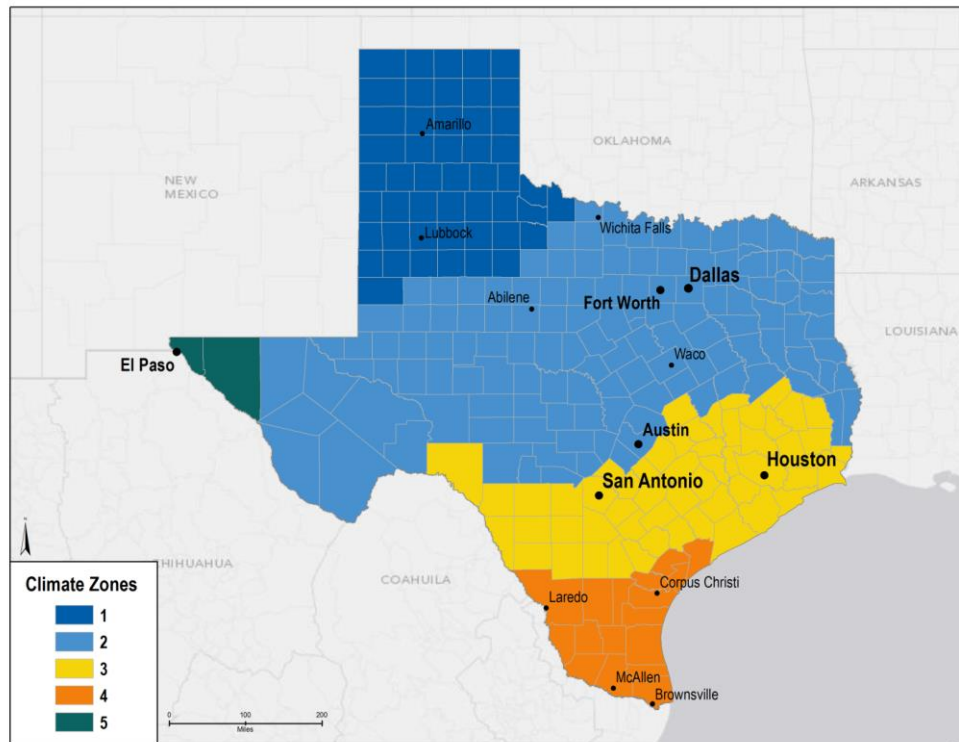

Module. The default action in the Module screen allows the user to select a product for which required performance data has been pre-loaded into the SAM. Several CertainTeed Apollo modules and Dow DPS-XXX modules can be specified in this window. However, modeling options for the PV Module can be modified in SAM 2015.6.30; by selecting the dropdown menu that, by default, is set to “CEC Performance Model with Module Database” (at the top of this window). Other modeling options provide the flexibility needed to adequately model products from other manufacturers.

- **Temperature Correction.** The module screen includes a “Temperature Correction” window, in which one of two-cell temperature; models must be specified. The “Nominal operating cell temperature (NOCT) method” should be selected, and within the “Nominal

output cell temperature (NOCT) parameters” section, the “Mounting standoff” should be specified as “Building integrated.” The “Building integrated” option accounts for the fact that, by their nature, solar shingles are integrated into the buildings on which they are installed.

Inverter. Inverter-specific information must be provided. Similarly to the functioning of the Module screen, an inverter can be selected from the Inverter CEC Database (default), or for inverters not in the CEC database, by specifying data from the manufacturer’s datasheet (Inverter Datasheet mode) or by specifying inverter efficiency at different loading rates (Inverter Part Load Curve mode), from which the inverter part load curve can be constructed. Any of these methods is satisfactory. Note that the number of inverters can be specified on the following (Array) screen, but only one inverter type can be specified here, so when multiple inverters are used with systems modeled in SAM, they must be the same make and model.

System Design (Array). The following array-level information shall be provided:

- System sizing: specified by solar module capacity and count, and inverter system losses.
- Configuration at reference conditions (Modules and Inverters) DC subarrays. SAM allows for modeling of up to 4 subarrays. If the system being modeled has only one array, the data for this array are entered in the column for subarray 1, and subarrays 2-4 should be left disabled. If there are multiple arrays, check the boxes to enable subarrays 2—4 as needed, and the number of strings in that subarray provided. Pre-inverter derates should be specified as appropriate.
- Estimate of overall land usage. Not needed (used for economic analysis only).
- PV subarray voltage mismatch. For CEC modules (true of CertainTEED and Dow DPS products), losses due to subarray mismatch can be estimated. For arrays with multiple orientations, this option should be selected.

Shading and Snow. A good faith effort should be made to represent features likely to affect incidence of solar radiation on the solar shingle system. Appropriate shading for the installation site should be incorporated; however, it is not necessary to modify the annual average soiling, as first year generation values will be used.

Losses. Specify all DC and AC losses.

For the remaining topics/screens listed below, no data entry is required:

- Lifetime
- Battery storage
- System costs
- Financial parameters
- Incentives
- Electricity rates
- Electric load

Model Run and Data Output

Execute the model calculations (in 2015.6.30) by clicking “Simulate” in the bottom left corner. SAM generates a large number of output data fields: create an 8,760 hourly output file by selecting “Time Series” at the top of the screen (option appears only after clicking “Simulate”) and then selecting “Power generated by system (kW)” from the options on the right-hand side of the screen. Output data can be sent to either Excel or CSV by right clicking on the generated plot and selecting the desired option.

Deemed Energy and Demand Savings Tables

There are no lookup tables available for this measure. See SAM software tool guidance in the previous section for calculating energy and demand savings.

Claimed Peak Demand Savings

Peak demand savings should be extracted from the hourly data file in a manner consistent with the definition of peak demand incorporated in TRM 3.0 and the associated methods for extracting peak demand savings from models producing 8,760 hourly savings using Typical Meteorological Year (TMY) data. See TRM volume 1 section 4.

Additional Calculators and Tools

Not applicable.

Measure Life and Lifetime Savings

Not applicable.

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified within the program database to inform the evaluation and apply the savings properly.

- Decision/action type: Retrofit, new construction
- Building type
- Climate/weather zone
- System latitude
- System tilt from horizontal
- System azimuth

The following files should be provided to the utility from which the project sponsor seeks to obtain an incentive for a solar shingles system installation:

- SAM model file (*.zsam format)
- 8760 hourly output file (csv or similar format)
- Calculator with annual energy savings and peak demand savings estimate

References and Efficiency Standards

Petitions and Rulings

Not applicable.

Relevant Standards and Reference Sources

- National Electric Code (NEC) 690, “Solar Photovoltaic Systems” or local building codes.
- Institute of Electrical and Electronics Engineers (IEEE) Standard 929-2000 “Recommended Practice for Utility Interface of Photovoltaic (PV) Systems.”
<http://standards.ieee.org/findstds/standard/929-2000.html>.
- System Advisor Model (SAM) Version 2014.1.14. National Renewable Energy Laboratory. SAM is available for registration and download at:
<https://sam.nrel.gov/download>.

Document Revision History

Table 43: M&V Solar Shingles Revision History

TRM Version	Date	Description of Change
v3.0	4/10/2015	TRM v3.0 origin.
v3.1	11/05/2015	Major methodology updates include revising the reference to latest version of SAM software and removal of TMY2 weather data file use. Revised measure details to match format of TRM volumes 2 and 3. This included adding detail regarding Measure Overview, Measure Description, Measure Life, Program Tracking Data and Evaluation Requirements, References and Efficiency Standards, and Document Revision History.
v4.0	10/10/2016	No revisions.
v5.0	10/10/2017	No revisions.
v6.0	10/2018	No revisions.
v7.0	10/2019	No revisions.

2.4 M&V: MISCELLANEOUS

2.4.1 Behavioral Measure Overview

TRM Measure ID: NR-MS-BC

Market Sector: Commercial

Measure Category: Miscellaneous

Applicable Building Types: Commercial

Fuels Affected: Electricity

Decision/Action Types: Operation and maintenance (O&M)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V and whole facility measurement

This protocol is used to estimate savings for various behavioral or practice changes that may be implemented on an ongoing (i.e., permanent) basis such that savings remain persistent and reliable long term. The development of the M&V methodology is driven by the desire to create and implement a framework to provide high quality verified savings—keeping within the standards currently applied to commercial energy savings measures—to implement measures and report energy savings from a wide variety of energy optimization practices and behaviors.

Measure Description

This measure is not defined but requires that any behavioral measure develop an M&V plan and report. These documents shall include a complete description of the proposed behavioral changes, how the changes will save energy, and why the behavioral change should be considered as a permanent change on par with high efficiency equipment retrofits. One example is to establish an authorized and enforced facility-wide energy policy with implementation and quality assurance processes.

The projects M&V plan and report shall describe the current case and proposed new case that define changes in operations and/or sequence of operations. These documents should fully discuss, describe, and document the logic of the proposed changes and how those changes translate into energy savings impacts.

The measure description should describe how the initial energy savings estimates will be determined to estimate energy and demand savings impacts that will then be verified by measurement and verification analysis following IPMVP criteria.

Eligibility Criteria

This measure applies to implementing behavioral measures that establish processes to ensure persistent energy reductions that are measurable at the facility level.

Baseline Condition

The baseline condition for each behavioral measure included in a plan has two facets: 1) to establish the existing operating parameters (e.g., temperatures, hours of operation, loads) and existing energy use for each behavior change included in the plan, and; 2) establish the proposed new case operating parameters resulting from each behavior change and present the equations proposed to quantify energy savings impact estimates.

The plan should document the source and accuracy/confidence of the various parameters used in the proposed equations to estimate baseline and new case energy use, for each behavior impact (e.g., if interior lights are to be turned off, there may be two sources of energy savings, one attributable directly to the light fixture energy use, the other attributable to reduced internal heat gain and load on the air conditioning system). The plan shall explain all assumptions employed for both baseline and behavior change cases noting source and applicability—logic reasoning.

High-efficiency Condition

Demonstrated by conclusive energy savings results of M&V plan following IPMVP protocols.

Energy and Demand Savings Methodology

Not applicable.

Savings Algorithms and Input Variables (Used to Estimate Initial Savings Potential Only)

Savings equations, algorithms, and input variables should be used as an initial means to estimate energy savings prior to measure implementation. These must adhere to standard engineering practices and accepted energy efficiency engineering methods. Initial savings estimates must identify energy savings calculations, algorithms and all pertinent factors used to calculate the estimated energy impacts of the project. Project M&V plans shall appropriately cite technical sources and resources used to develop initial energy savings estimates. These initial savings estimates, although to be replaced with final whole facility EM&V determined savings, should be included in the final M&V report of savings.

Whole Facility EM&V Methodology (Used to Estimate Final Savings Potential)

A whole facility EM&V methodology presents a plan to determine energy savings due to significant and persistent facility-wide behavioral changes for a commercial facility. This methodology measures and verifies initial energy savings estimates. The plan follows procedures guided by whole facility Option C in the International Performance Measurement and Verification Protocol (IPMVP). The development of the whole facility measurement methodology is driven by the desire to create and implement a framework to provide high quality verified savings while keeping within the standards currently used to verify commercial measures. The whole facility guidance is found in the latest version of the IPMVP Volume 1 EVO 10000-1:2012.

The Option C methodology should be documented in a M&V report and include detail regarding model development, testing, handling of errors, and the information for validating the regression model(s). Model documentation should be transparent and allow for repeating modeling steps and results, including the use of any adjustments made outside of the primary modeling method. Procedures to be taken and their respective results should be documented and may include:

- Describe the process taken for how the review of outliers was completed, whether outliers were identified, and how those outliers were addressed in the modeling. Describe how any missing data points or data entry errors were addressed and document what was missing, corrected, or erroneous data were changed from the original data for purposes of the model. Any data that are ultimately removed or changed from the original data set should be annotated with the assignable cause.
- Present the guidelines used to test for the statistical significance of each independent variable and overall model fitment. The results of these statistical tests and results should be presented as part of the presentation of individual model results.

M&V Plan and M&V Report

Preparation of an M&V plan and ultimately an M&V report is required to determine savings. Advanced planning ensures that all data collection and information necessary to determine savings will be available after implementation of the behavioral change(s). The project's M&V plan and M&V report provide a record of the initial energy savings impact estimates, and the data collected during project development and implementation. These documents may also serve multiple purposes throughout a project including recording critical assumptions and conditions, and any changes that may emerge during project implementation. For example, the M&V plan shall describe how major energy drivers will be documented and recorded. The M&V report shall document such findings. Also, other energy savings influences (e.g., equipment retrofits, changes to occupancy) that may have occurred during the baseline and/or reporting periods are to be accounted for and quantified. Such savings development and assumptions should be clearly documented within the M&V report. Documentation should be complete, readily available, clearly organized, and easy to understand.

Changes to the required level of documentation may be possible if a viable comparison group can be used for the analysis, but in using a comparison group, the EM&V team needs to review the make-up and selection of the group and that using a comparison group in lieu of other documentation should be presented in a draft M&V plan.

The methodology described herein involves use of whole facility electric meter data. An important component of a project is to identify the existing base and new case system information.

In addition to documenting existing and new equipment information, IPMVP describes the following requirements as part of the M&V plan and M&V report contents. These requirements are listed below, and the user is directed to the current version of IPMVP for further detail and guidance.

- Measure intent
- Selected IPMVP option and measurement boundary
- Baseline—Period, energy and conditions
- Reporting period

- Basis for adjustment
- Analysis procedure
- Energy prices (as applicable)
- Meter specifications
- Monitoring responsibilities
- Expected accuracy
- Budget (as applicable)
- Report format
- Quality assurance

Considerations and Recommendations

Consideration #1: Sufficient post-program data to estimate savings

The annual reporting of program savings poses a challenge to accurately estimating impacts from behavioral programs in Texas as 12 months of pre- and post-data are needed to account for seasonal variations. Having 12-months of data is the recognized industry-standard practice as specified in the Department of Energy's Uniform Methods Project (UMP):

"these [behavioral] programs may influence weather-sensitive energy uses, such as space heating or cooling, so collecting less than one year of data to reflect every season may yield incomplete results."²⁵

Recommendation #1: Behavioral programs should award incentives and claim savings for 40 percent of projected savings in the first program year and award the remaining incentives and claim savings the next program year once 12 months of post-program data is available to complete the M&V.

In Texas, a precedence has been established for awarding incentives and claiming savings for custom commercial programs where the required M&V to calculate savings spans program years. In these cases, 40 percent of the incentives are awarded, and savings claimed the first program year based on initial estimated savings. Then in the subsequent program year when M&V is completed, the remaining 60 percent or "true-up" of estimated savings is paid and incentives are awarded. The EM&V team asserts that a similar process should be used to estimate behavioral program savings.

Consideration #2: Measure life

²⁵ The Uniform Methods Project: Methods for Determining Energy Efficiency Savings for Specific Measures, Chapter 17: Residential Behavior Protocol, page 20. While a specific nonresidential behavior protocol is not included in the UMP, this chapter recognizes the same approach is applicable to nonresidential programs though there has been less research and implementation of these programs.

The TRM Behavioral Program M&V Protocol (Vol 4, Section 2.4.1) states that measure life/lifetime savings are not applicable to behavioral programs (p. 2–40) as only annual savings are to be claimed.

Recommendation #2: Utilities should only claim annual savings for behavioral programs until M&V demonstrates measure persistence

The persistence of behavioral savings after the intervention (e.g., program outreach) has ended is widely debated in the industry and it is recognized that additional research is needed on the persistence of behavioral savings.²⁶ While there has been some, though still limited, research for home energy reports for residential programs, there is very little research on savings persistence for nonresidential behavioral programs.

Deemed Energy and Demand Savings Tables

Not applicable.

Claimed Peak Demand Savings

Refer to TRM Volume 1, Section 4.2: Approach to Identifying Peak Hours for further details on peak demand savings and methodology derived using the whole facility EM&V process. This should be presented in the project M&V plan.

Additional Calculators and Tools

The project M&V plan shall describe analysis calculators or software tools employed and their applicability for project analysis.

Measure Life and Lifetime Savings

The estimated useful life (EUL) is one year.

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified and tracked within the program database to inform the evaluation and apply the savings properly.

- Decision/action type: O&M
- Building type
- Climate zone
- Baseline equipment types affected by behavior change
- Baseline equipment capacities
- Baseline equipment efficiency ratings

²⁶ The Uniform Methods Project: Methods for Determining Energy Efficiency Savings for Specific Measures, Chapter 17: Residential Behavior Protocol, page 14.

- Baseline number of units
- Baseline operating practice
- Efficient operating practice

References and Efficiency Standards

Not Applicable.

Petitions and Rulings

- Behavioral programs are allowed energy efficiency programs as specified in the Energy Efficiency Rule (16 TC 25.181 (c)(12))

Relevant Standards and Reference Sources

- Unique to each project and to be documented in M&V plan and report.

Document Revision History

Table 44: M&V Behavioral Revision History

TRM Version	Date	Description of Change
v3.1	11/05/2015	TRM v3.1 origin.
v4.0	10/10/2016	Updated documentation of methodology and measure life.
v5.0	10/10/2017	No revisions.
v6.0	10/2018	No revisions.
v7.0	10/2019	Transferred relevant guidance language from Vol. 5

2.4.2 Air Compressors less than 75 hp Measure Overview

TRM Measure ID: NR-MS-CA

Market Sector: Commercial

Measure Category: Miscellaneous

Applicable Building Types: Commercial

Fuels Affected: Electricity

Decision/Action Types: Early retirement (ER), new construction (NC), and replace-on-burnout (ROB)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V and whole facility measurement

This protocol is used to estimate savings for compressed air system controls measures for systems with less than 75 horsepower in total compressor power. The development of this compressed air methodology is driven by the desire to create and implement a framework to provide high quality verified savings for smaller compressed air projects. This measure uses site collected data, follows savings methodologies as outlined by the Ohio Technical Reference Manual, and uses research on compressed air systems conducted by the Long Island Power Authority.

Measure Description

This measure requires the installation of flow controls on existing compressed air systems with a total compressor power of less than 75 hp. This methodology limits the amount of savings that can be claimed to 20 kW and 100,000 kWh for projects. For projects that are expected to exceed 20 kW or 100,000 kWh, full M&V is recommended to claim savings.

Applicable controls measure types include:

- **Load/unload controls:** allow the motor to run continuously at a constant speed but unloads the compressor when adequate pressure has been achieved. Efficient load/unload controls use storage tank(s) to increase the available compressor air capacity without requiring compressor operation during all load periods. This protocol provides estimated savings for systems that exceed 3 gal/CFM or 5 gal/CFM in storage capacity.
- **Modulating inlet controls:** vary the output of the compressor to meet the flow requirements of the system. Modulating flow controls offer limited energy savings from the potential for a surge in demand the minimum throttling capacity.
- **Variable displacement systems:** have compressors that are designed to operate in two or more partially-loaded conditions. Since the compressor can operate efficiently at multiple output points, it can more closely align with the load of the system.
- **Variable speed w/unloading:** controls the compressor motor to precisely match the load of the system, offering the highest efficiency gains. During periods of very low demand,

the compressor is unloaded and will operate at the minimum variable speed output until the demand exceeds the minimum output of the compressor, as determined by system flow and pressure.

Eligibility Criteria

This measure applies to retrofitting an existing compressed air system with a new, higher efficiency flow control type or the installation of a new compressed air system with eligible flow control types integrated.

Baseline Condition

Existing System Retrofit: The baseline for existing system retrofit shall be the applicable control type from the pre-existing system, from Table 45.

Replace-on-Burnout (ROB) and New Construction (NC): The baseline for ROB and NC projects is assumed to be a modulating air compressor with blow down, to align with standard industry practice. The baseline efficiency is given from the Modulation category in Table 45.

High-efficiency Condition

High-efficiency conditions for compressed air system are given in Table 45.

Table 45: Air Compressor Energy Factors

Control Type	ACEF	Source
Modulation	89.0%	LIPA Clean Energy Initiative ²⁷
Load/No Load w/ 3 gal/CFM	83.1%	
Load/No Load w/ 5 gal/CFM	80.6%	
Variable Displacement	76.9%	
Variable Speed w/ Unloading	67.5%	

²⁷ Data obtained from Long Island Power Authority's Clean Energy Initiative, See ACEF Development section for more details.

Energy and Demand Savings Methodology

Whole Facility EM&V Methodology (Used to Estimate FINAL Savings Potential)

Standard IPMVP Option A procedures will be used to compare stipulated value to actual site conditions. The purpose is to confirm or adjust system values found in the Ohio TRM, Long Island Power Authority's Clean Energy Initiative, Arkansas C&I program, and Texas Pilot Program. "Measurement and Verification" (M&V) is the process of using measurement to reliably determine actual savings created within an individual facility by an energy management program. Savings cannot be directly measured since they represent the absence of energy use. Instead, savings are determined by comparing measured use before and after implementation of a project, making appropriate adjustments for changes in conditions.

Option Type and Measurement Boundary

This measurement and verification plan will follow the guidelines of the 2012 International Performance Measurement and Verification Protocol (IPMVP) Option A—Retrofit Isolation: Key Parameter Measurement. This method calculates energy savings using key energy consumption parameters before the equipment retrofit begins and after the retrofit is completed. The Option A guidelines are described in the latest version of the IPMVP Volume 1 EVO 10000-1:2012.

The key parameters being measured is interval true power (kW).

Baseline and Reporting Period

Two weeks of logging data before and two weeks of logging data after will be collected.

Savings Methodology—Measured Data Analysis

The following equations will be used to calculate energy and demand saving estimates:

$$\text{Peak Demand Savings (kW)} = kW_{PDPF,existing} - kW_{PDPF,new}$$

Equation 51

$$\text{Annual Energy Savings (kWh)} = (kW_{avg\ op,existing} - kW_{avg\ op,new}) * \text{Hours}$$

Equation 52

Where:

$$kW_{PDPF} = \text{Compressor motor kW from metered data corresponding to PDPF period as outlined in TRM Volume 1}^{28}$$

²⁸ TRM Volume 1 Section 4.7 provides a basis for estimating peak coincident demand reductions attributable to the implementation of energy efficiency measures in Texas. This is based on measure-specific load during the identified peak hours according to section 4.2.2.

$kW_{avg, op}$ = Average compressor motor kW from metered data during the operating hours

Hours = Compressor total hours of operation per year; assumed to be the facility posted annual operating hours

Savings Methodology—Stipulated Analysis

The following equations will be used to calculate energy and demand saving estimates:

$$\begin{aligned} \text{Peak Demand Savings (kW)} \\ &= (kW_{full\ load, existing} * ACEF_{existing} - kW_{full\ load, new} * ACEF_{new}) * CF_{PDPF} \end{aligned}$$

Equation 53

$$\begin{aligned} \text{Annual Energy Savings (kWh)} \\ &= (kW_{full\ load, existing} * ACEF_{existing} - kW_{full\ load, new} * ACEF_{new}) * Hours \end{aligned}$$

Equation 54

$$kW_{full\ load, existing} = \frac{0.7456 * \text{Motor Nominal HP}_{existing} * LF_{rated}}{\text{Motor Nominal Efficiency}_{existing}}$$

Equation 55

Where:

$kW_{full\ load}$ = Compressor motor full load kW from CAGI data sheet; if Baseline CAGI data isn't available, use Equation 55

Hours = Compressor total hours of operation per year; assumed to be the facility posted annual operating hours

ACEF = Air compressor energy factor from Table 45

LF_{rated} = Total annual energy consumption as reported in utility meter data for the post-retrofit measurement year

CF_{PDPF} = Coincident factor determined from peak demand probability factors; for projects whose business hours encompass the entire PDPF period for the building's climate zone, the factor is 1.0²⁹

Deemed Energy and Demand Savings

There are no deemed energy or demand savings for this measure.

²⁹ TRM volume 1, section 4.2 provides a basis for estimating peak coincident demand reductions attributable to the implementation of energy efficiency measures in Texas. This is based on measure-specific load during the identified peak hours according to section 4.2.2.

Claimed Peak Demand Savings

A summer peak period value is used for this measure. Refer to Volume 1, Appendix B: Peak Demand Reduction Documentation for further details on peak demand savings and methodology.

Additional Calculators and Tools

The regression software used for estimating annual energy use and demand should be clearly specified within the M&V plan and M&V report.

ACEF Development

As part of the Long Island Power Authority (LIPA) Clean Energy Initiative, a study of air compressors was conducted. The study collected data on the operating capacity of the compressed air systems. LIPA provided data from this study, which was used as the basis for the ACEF development.

The capacity data was divided into percent of full-load capacity bins to determine the average system loading across the population. This data was weighted by the brake horsepower of each compressor in the population. Then for each capacity bin, the percent power was determined for the control schemes from the Department of Energy air compressor calculator savings calculator (no longer publicly available). The percent power curves were then used with the load profile determined from the study data to develop the average compressor energy factors for each control scheme for this measure.

Measure Life and Lifetime Savings

The EUL for commercial air compressors is set to the Texas default of 10 years pending further research.

Program Tracking Data and Evaluation Requirements

The following primary inputs and contextual data should be specified and tracked within the program database to inform the evaluation and apply the savings properly.

- Decision/action type: ER, ROB, NC, system type conversion
- Building type
- Climate zone
- Baseline equipment type
- Baseline equipment controls
- Baseline number of units
- Baseline compressor CAGI data sheets
- For ER only: Baseline age and method of determination (e.g., nameplate, blueprints, customer reported, not available)
- Installed equipment type
- Installed equipment controls

- Installed equipment make and model
- Installed number of units
- Installed compressor CAGI data sheets
- A description of the actual building type, the primary business activity, the business hours, and the operating schedule

Petitions and Rulings

- Not applicable.

Relevant Standards and Reference Sources

- State of Ohio Energy Efficiency Technical Reference Manual, http://s3.amazonaws.com/zanran_storage/amppartners.org/ContentPages/2464316647.pdf.

Document Revision History

Table 46: Air Compressors less than 75 HP Revision History

TRM Version	Date	Description of Change
v5.0	10/10/2017	TRM v5.0 origin.
v6.0	10/2018	No revisions.
v7.0	10/2019	No revisions.

2.4.3 Commercial Retro-commissioning

TRM Measure ID: NR-MS-RC

Market Sector: Commercial

Measure Category: Miscellaneous

Applicable Building Types: Commercial

Fuels Affected: Electricity, natural gas

Decision/Action Types: Operational/maintenance

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V and whole facility measurement

This protocol is used to estimate savings for retro-commissioning (RCx) projects where a substantial portion of the savings are expected to come from operational and maintenance (O&M) activities. Since RCx often involves improvements through control system optimization, maintenance changes, and other system-level enhancements, determining savings often involves numerous assumptions and extensive interactive effects. This protocol provides a framework for calculating savings for projects involving whole building or sub-system monitoring.

Measure Description

Retro-commissioning is a systematic process to improve a building's existing equipment and energy systems. RCx involves an assessment of the all energy systems contained within a building and applies energy savings strategies to reduce overall energy use. The process usually begins with an energy audit of the building, an inventory of building equipment, development of energy conservation measures (ECMs), cost-benefit analysis of ECMs, and implementation of selected ECMs.

ECMs that may be considered in RCx projects include:

- Identification of maintenance issues observed during the energy audit, plans for fixing the issues, and planning for identification of similar issues in the future.
- Development of optimization strategies in existing systems, including correcting air balancing issues, controls reductions of simultaneous heating/cooling operations, and incorrect control sequences.
- Implementation of control system strategies, or optimization of existing strategies, including economizer setpoint control, demand-controlled ventilation, HVAC occupancy schedules, hot water reset, chilled water reset, and system lockout temperatures.
- Maintenance scheduling improvements aimed to keep equipment operating at peak condition through proper adherence to manufacturer's recommended maintenance and advanced identification of issues through personnel inspections or control system parameters.

- Replacement options for aged equipment or development of a plan for future replacement of equipment.

Eligibility Criteria

Comprehensive RCx projects must be compliant with IPMVP-Option C. Projects should have the expectation of savings greater than 10% utility bill (or sub-metered) energy use. The final analysis is expected to have a coefficient of determination (R^2) equal to or above 75%. Project sponsors should contact the EM&V team for approval of RCx projects that result in less than 10% energy savings and/or R^2 less than 75%. For RCx projects with smaller savings (< 20 kW) where M&V efforts may be cost prohibitive, simplified strategies to reduce M&V costs (e.g., using TRM values for lighting fixture wattage) will be considered with prior EM&V-team approval.

Baseline Condition

The baseline condition is the existing building energy use, prior to the engagement of initial retro-commissioning activities.

High-efficiency Condition

The high-efficiency condition is the building or system energy use after implementation of retro-commissioning ECMs as agreed upon between the customer, utility, and/or third-party contractors.

Energy and Demand Savings Methodology

Whole Facility EM&V Methodology

IPMVP Option C will be used as the basis of analysis for operational and maintenance savings from retro-commissioning projects. Where a significant portion of the energy/demand savings is expected to come from prescriptive measures or custom measures whose savings have been independently determined through sub-system modeling (greater than 50% from a preliminary assessment), savings should be claimed following this M&V methodology exclusively OR savings should be claimed for the prescriptive measures and custom measures ONLY to prevent overstating savings due to interactive effects.

Since most O&M savings involve HVAC systems, which are inherently driven by climatological factors, the whole facility analysis should use a normalization approach for the weather dependent factors. Typical meteorological year (TMY) data should be used in the pre and post regression results to estimate normalized savings for comprehensive RCx projects.

Option Type and Measurement Boundary

The measurement and verification plan will follow the guidelines of the 2012 International Performance Measurement and Verification Protocol (IPMVP) Option C-Whole Facility. This method calculates energy savings for the whole facility, or sub-facility, level based on regression analysis techniques outlined in IPMVP 2012.

The key parameter being measured is interval true power (kW) with secondary factors including ambient temperature and operational characteristics (such as occupancy or production levels). The measured parameters, and their sources of data, should be clearly outlined in the M&V plan and revisions or adjustments should be well documented in the M&V report.

Baseline and Reporting Period

Where possible, one year of pre and post utility, building, or system level data is preferred for conducting a regression analysis. Where less than a year of data is not feasible, methodologies should be considered on a case-by-case basis and agreed upon with the M&V team.

Savings Methodology—Measured Data Analysis

The following equations will be used to calculate energy and demand saving estimates:

$$\text{Peak Demand Savings (kW)} = kW_{PDPF, \text{existing}} - kW_{PDPF, \text{new}} \pm kW_{\text{adjustments}} - kW_{\text{other meas}}$$

Equation 56

$$\text{Energy Savings (kWh)} = kWh_{\text{existing}} - kWh_{\text{new}} \pm kWh_{\text{adjustments}} - kWh_{\text{other meas}}$$

Equation 57

Where:

$kW_{PDPF, \text{existing}}$	=	Building or system level kW for the existing building/system from metered data corresponding to PDPF period as outlined in TRM volume 1. ³⁰
$kW_{PDPF, \text{new}}$	=	Building or system level kW for the post retro-commissioning building/system from metered data corresponding to PDPF period as outlined in TRM volume 1. ³⁰
kWh_{existing}	=	Building or system level kWh for the existing building/system from metered data.
kWh_{new}	=	Building or system level kWh for the post retro-commissioning building/system from metered data.
$kW/kWh_{\text{adjustments}}$	=	Adjustments to the kW and kWh building/system metered data results that account for operational changes which are not attributable to the retro-commissioning project.
$kW/kWh_{\text{other meas}}$	=	Adjustments to the kW and kWh building/system metered data results that account for prescriptive and custom measures which are calculated independently.

³⁰ TRM volume 1, section 4.2 provides a basis for estimating peak coincident demand reductions attributable to the implementation of energy efficiency measures in Texas. This is based on measure-specific load during the identified peak hours according to section 4.2.2.

Deemed Energy and Demand Savings

There are no deemed energy or demand savings for this measure. Prescriptive savings for individual measures may be calculated in accordance with other commercial measures in Volume 3 and Volume 4 if an initial assessment indicates they are less than 50% of the total project savings.

For smaller-scale RCx projects that will result in smaller savings (<20 kW), a simplified M&V approach may be used, pending EM&V contractor pre-approval. These smaller RCx projects will be considered on a case-by-case basis.

Claimed Peak Demand Savings

The methodology used to determine the peak demand savings should be consistent with the methodology of the energy savings. Furthermore, the calculation of peak demand savings should into account the weather dependent peak demand probability factors, as outlined in Volume 1. The methodology should be documented clearly in the M&V plan and M&V report.

Additional Calculators and Tools

The regression software used for estimating annual energy use and demand should be clearly specified within the M&V plan and M&V report.

Measure Life and Lifetime Savings

The EUL for retro-commissioning projects is set to 5 years pending further research for O&M measures.³¹

Program Tracking Data and Evaluation Requirements

The following should be documented in the M&V plan and M&V report:

- Decision/action type: O&M
- Building type

Petitions and Rulings

Not applicable.

Relevant Standards and Reference Sources

- International Performance and Measurement Verification Protocol
<https://evo-world.org/en/products-services-mainmenu-en/protocols/ipmvp>

³¹

<https://www.swenergy.org/data/sites/1/media/documents/publications/documents/SWEEP%20Industrial%20Retrocommissioning%20Feb%202017.pdf>.

Document Revision History

Table 47: Commercial Retro-commissioning Revision History

TRM Version	Date	Description of Change
v6.0	10/2018	TRM v6.0 origin.
v7.0	10/2019	TRM v7.0 update. Clarifications for small project exemptions and proper use of IPMVP Option C. Correction for erroneous eligibility criteria in v6.0.

2.4.4 Thermal Energy Storage Measure Overview

TRM Measure ID: NR-MS-TS

Market Sector: Commercial

Measure Category: Miscellaneous

Applicable Building Types: Commercial

Fuels Affected: Electricity, natural gas

Decision/Action Types: Retrofit (RET), new construction (NC)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V

This protocol is used to estimate savings for thermal energy storage (TES) projects. TES projects are any system design that uses heat transfer to a medium during off-peak hours or non-critical seasonal periods and then uses the stored heat during the on-peak hours or critical seasonal period. TES systems often have non-energy benefits (economic, equipment sizing, etc.) while having negligible, or even negative, energy savings.

Measure Description

Thermal energy storage systems represent a wide range of available technologies. Potential TES systems under this protocol include, but are not limited to, solar energy storage, molten-salt technologies, ice-based technologies, general heat storage in any technology, miscibility gap alloy technology, cryogenic energy storage, and hot silicon technology.

Eligibility Criteria

TES projects must be compliant with IPMVP Option A, B, or C. For Option C consideration, the project should save more than 10% of peak demand for electricity. For Option B, full M&V of the thermal energy storage system and affected systems is expected. For Option A, the assumptions that support monitoring of only key datapoints should be discussed with the EM&V team prior to M&V plan development. An M&V plan should be developed when using Options A or B and approved by the EM&V team prior to the conducting of any metering for the project.

Baseline Condition

The baseline condition is the existing building energy use systems (retrofit) or minimal code-compliant systems (new construction).

High-efficiency Condition

The high-efficiency condition is the building with the thermal energy storage system.

Energy and Demand Savings Methodology

Whole Facility EM&V Methodology

IPMVP Option C can be used as the basis of analysis for thermal energy storage systems. If the thermal energy storage system is expected to have daily cycling, metering intervals must be 30-minutes or less (preferably 15-minutes) for all affected fuel types. Options A or B can be used when interval data is not available. The expected peak demand reduction from the TES must exceed 10% to attempt an Option C analysis and analyzed trends must exceed an R^2 of 0.75. Further, all hours defined in the Volume 1 PDPF tables for the project's climate zone must be directly metered, as well as representative weather periods must be observed during the monitoring period. For TES systems with seasonality cycling, the monitoring interval can be increased and must be approved by the M&V team on a case-by-case basis.

For projects that wish to follow, or need to follow, an IPMVP Option A or B path, all necessary parameters must be directly metered, or the assumptions need to be approved by the EM&V team. These may include the power use of affected systems, temperatures of storage mediums, flow rates of liquids, etc. An M&V plan for Option A or B TES projects should be developed and approved by the EM&V team prior to conducting metering.

Baseline and Reporting Period

The baseline and reporting periods for TES systems will be approved on a case-by-case basis by the EM&V team.

Savings Methodology

The following equations will be used to calculate energy and demand saving estimates:

$$\text{Peak Demand Savings (kW)} = kW_{PDPF, \text{existing}} - kW_{PDPF, \text{new}} \pm kW_{\text{adjustments}} - kW_{\text{other mees}}$$

Equation 58

$$\text{Energy Savings (kWh)} = kWh_{\text{existing}} - kWh_{\text{new}} \pm kWh_{\text{adjustments}} - kWh_{\text{other mees}}$$

Equation 59

Where:

$kW_{PDPF, \text{existing}}$ = Building or system level kW for the existing building/system from metered data corresponding to PDPF period as outlined in TRM volume 1.³²

$kW_{PDPF, \text{new}}$ = Building or system level kW for the post TES building/system from metered data corresponding to PDPF period as outlined in TRM volume 1.³²

³² TRM volume 1, section 4.2 provides a basis for estimating peak coincident demand reductions attributable to the implementation of energy efficiency measures in Texas. This is based on measure-specific load during the identified peak hours according to section 4.2.2.

$kWh_{existing}$	=	<i>Building or system level kWh for the existing building/system from metered data.</i>
kWh_{new}	=	<i>Building or system level kWh for the post TES building/system from metered data.</i>
$kW/kWh_{adjustments}$	=	<i>Adjustments to the kW and kWh building/system metered data results that account for operational changes which are not attributable to the TES project.</i>
$kW/kWh_{other\ meas}$	=	<i>Adjustments to the kW and kWh building/system metered data results that account for prescriptive and custom measures which are calculated independently.</i>

Deemed Energy and Demand Savings

There are no deemed energy or demand savings for this measure.

Claimed Peak Demand Savings

The methodology used to determine the peak demand savings should be consistent with the methodology of the energy savings. Furthermore, the calculation of peak demand savings should into account the weather dependent peak demand probability factors, as outlined in Volume 1. The methodology should be documented clearly in the M&V plan and M&V report.

Additional Calculators and Tools

Any regression software used for estimating annual energy use and demand should be clearly specified within the M&V plan and M&V report.

Measure Life and Lifetime Savings

The EUL for thermal energy storage projects is set to 15 years, pending further research for specific TES measures.

Program Tracking Data and Evaluation Requirements

The following should be documented in the M&V plan and M&V report:

- Decision/action type
- Building type

Petitions and Rulings

Not applicable.

Relevant Standards and Reference Sources

- International Performance and Measurement Verification Protocol
<https://evo-world.org/en/products-services-mainmenu-en/protocols/ipmvp>

- U.S. Department of Energy: M&V Guidelines: Measurement and Verification of Performance-Based Contracts (Version 4.0)
https://www.energy.gov/sites/prod/files/2016/01/f28/mv_guide_4_0.pdf

Document Revision History

Table 48: Thermal Energy Storage Revision History

TRM Version	Date	Description of Change
v7.0	10/2019	TRM v7.0 origin.

2.5 M&V: LOAD MANAGEMENT

2.5.1 Residential Load Curtailment Measure Overview

TRM Measure ID: R-LM-LM

Market Sector: Residential

Measure Category: Load management

Applicable Building Types: Single family, multifamily, and manufactured homes

Fuels Affected: Electricity

Decision/Action Types: Operation and maintenance (O&M)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V

Utilities operate residential load management programs to obtain demand savings: to the extent energy savings are also estimated, they are estimated as a function of the estimated demand savings.³³ Demand savings calculations are performed using utility customer interval energy demand data from IDRs or advanced meters. Measured and verified demand savings for the curtailment period is presented here.

Measure Description

Measures participating in a residential load management program may be air-conditioners, heat pumps, swimming pool pumps, or other electricity loads as specified by utility program designs. Specific methods of load management for this measure are not defined and are determined by individual programs. The savings reflect the cumulative effect of all participant actions to reduce residence-wide demand during a load management event.

Eligibility Criteria

A project will be eligible for incentives and reporting demand and energy savings when continuous demand interval recording capability (30-minute intervals or less) and sufficient interval data exists to measure and verify sufficient comparison-days to establish demand baselines as well as interval demands during load management events. Participants are homes.

³³ Some utilities may determine energy savings associated with load management events, which would be calculated as the difference between the baseline and curtailment kW values times the length of the event(s).

Baseline Condition

The baseline condition is an individual participants' load that would have occurred had the load management event and subsequent load management activities not taken place.³⁴

High-efficiency Condition

Not applicable.

Energy and Demand Savings Methodology

Not applicable.

Savings Algorithms and Input Variables

$$\text{Verified Demand Savings} = \text{Baseline Period kW} - \text{Curtailment kW}$$

Equation 60

Where:

Baseline Period kW = *Baseline average demand calculated according to the High 3 of 5 Baseline Method*

Curtailment kW = *Average demand measured during the curtailment period*

High 3 of 5 Baseline with Day-of Adjustment

A high X of Y baseline considers the Y most recent days preceding an event and uses the data from the X days with the highest load within those Y days to calculate the baseline. Day-of adjustments are used to scale the baseline load estimate to the load conditions on the day of the event using data from the two hours prior to the time on the event day when participants were notified of the pending call for curtailment.

Applying this concept to the residential load management measure, the High 3 of 5 baseline for a given curtailment event is estimated by first identifying the five non-holiday weekdays immediately preceding the event in which no prior program curtailment events were called, and calculating each participant's average demand during the same hours as the hours for which the curtailment event was implemented on each of those five days. The three highest of these five average-like day demand values are then averaged to estimate the "unadjusted high three baseline".

The day-of baseline adjustment is estimated by comparing participants' average demand for electricity on the day of the event during the two hours prior to notification of the pending event (the "adjustment period") to participants' average demand for electricity on the "high

³⁴ Some utilities may determine energy savings associated with load management events, which would be calculated as the difference between the baseline and curtailment kW values times the length of the event(s).

three” days during those same two hours. In the situation where notification may not be given, the two hours preceding one hour before the event begins on the event day and baseline days will be used as the adjustment period. The average load of the adjustment period on the event day are compared to the average load of the adjustment periods from the baseline days. The difference (positive or negative) between day-of demand and high three baseline day demand in the adjustment period is the uncapped additive adjustment. To apply the adjustment period to the unadjusted baseline, one of two options are selected in the following steps:

- 1) Calculate an uncapped additive adjustment. The uncapped additive adjustment is the difference of the adjustment period hours’ load of the event day subtracted from the baseline days’ average adjustment period load. For example, if the baseline days have an adjustment period average load of 3.20 kW and the event day has an adjustment period load of 3.80 kW, the uncapped additive adjustment is $3.80 \text{ kW} (-) 3.20 \text{ kW} = 0.60 \text{ kW}$.
- 2) Calculate an adjustment cap. The adjustment cap is 80 percent of the baseline days’ average load during the event hours. For example, if a participant has a load of 4.00 kW during the baseline days’ event hours, the adjustment cap is $4.00 \text{ kW} (x) 0.80 = 3.2 \text{ kW}$.
- 3) Select the lowest of the adjustment cap and the absolute value of the uncapped additive adjustment to be the additive adjustment. Using the examples of the preceding two steps, the uncapped additive adjustment (0.60 kW) has the lowest magnitude between the two numbers and is selected as the additive adjustment.
- 4) Add the additive adjustment to the unadjusted High 3 of 5 baseline to calculate the final baseline used for calculating changes to consumption for the load management event.

Following the calculation of the baseline using the High 3 of 5 method, the following steps are taken to arrive at an event’s total savings and program savings for the year:

- 1) For an individual meter, the change in consumption is calculated by subtracting the baseline from the average load recorded during the event. If the result is positive, the meter exhibits savings, whereas a negative result indicates an increase in consumption during the event.
- 2) For a given load management event, sum the change in consumption of all participating meters. If documented, those meters enrolled in the program that opt-out of an event may be removed from the summation. If opt-out meters are not documented, an enrolled meter will be considered to have participated in the event. The sum represents the event’s total change in consumption, presumed to be positive and representing savings.
- 3) With each event’s savings results, average the event-level savings. The average of the events’ savings represents the program year savings.

An example, below, illustrates the entirety of applying the high 3 of 5 method to calculate load management savings for a single residential participant.

Example Calculation

Table 49 illustrates the steps of the High 3 of 5 baseline calculation method. Specific participant's results may vary.

Table 49. High 3 of 5 Example Load Management Event Data

Event Day and Potential Baseline Days	Potential Baseline Day 5	Potential Baseline Day 4	Potential Baseline Day 3	Potential Baseline Day 2	Potential Baseline Day 1	Load Management Event Date
Event hours	1500-1600	1500-1600	1500-1600	1500-1600	1500-1600	1500-1600
Average kW during event hours	5.67	5.96	4.95	4.58	6.01	5.12
Notification hour						1400
Adjustment period hours	1200-1400	1200-1400	1200-1400	1200-1400	1200-1400	1200-1400
Adjustment period average kW	5.54	5.87	4.86	4.44	5.89	6.03

Calculation Steps:

- 1) Unadjusted High Three Baseline = Average kW during event times in three highest days of five prior to event day (kW)

$$\text{Unadjusted High Three Baseline} = (5.67 + 5.96 + 6.01) / 3 = 5.88 \text{ kW}$$

- 2) Uncapped Additive Adjustment = Average kW during adjustment time on event day (kW)—Average kW during adjustment time in the same three highest days of five prior to event day

$$\text{Uncapped Additive Adjustment} = 6.03 - (5.54 + 5.87 + 5.89) / 3 = 0.26 \text{ kW}$$

- 3) Adjustment Cap = 80% of Unadjusted High Three Baseline (kW)

$$\text{Adjustment Cap} = 0.8 * 5.88 = 4.7 \text{ kW}$$

- 4) Choose Additive Adjustment = Minimum {Absolute value of Uncapped Additive Adjustment, Adjustment Cap} (kW)

$$\text{Additive Adjustment} = \text{Minimum} \{0.26, 4.7\} = 0.26 \text{ kW}$$

- 5) Final Baseline = Additive Adjustment + Unadjusted High Three Baseline (kW)

$$\text{Final Baseline} = 0.26 + 5.88 = 6.14 \text{ kW}$$

- 6) kW Savings = Final Baseline—Curtailment kW (kW)

$$\text{kW Savings} = 6.14 - 5.12 = 1.02 \text{ kW}$$

Additional Calculation Considerations

In the case that individual meters fail to record data sufficient for applying the High 3 of 5 calculation method, savings may still be calculated under the following conditions and method:

- Less than one percent of participating residential customers experience meter recording failures
- The customer can be confirmed as having participated via the practices of the sponsor operating the program or lack of opt-out notification
- The EM&V team is engaged to discuss applying the average savings and any program participation segmentation, and the specific cases are documented
- Savings for the residential segment will be calculated using the average savings of the segment as calculated via the High 3 of 5 method for the balance of the program or segment.

When selecting baseline days in the High 3 of 5 method, in some cases it is possible that some days have the same load for an individual participant, potentially leading to more than three days that could be selected for the baseline days. In the event that four or more days could be selected as baseline days based on their loads during event hours, the days with the highest loads and closest to the event should be picked for the baseline.

Program year kW load management event savings will be calculated as the average savings of all events.

Rounding

Utilities should round load management impacts consistent with how incentives are awarded, which is at the customer-level.

Meters

If there are random, non-systematic errors in smart meter data for less than one percent of total participants, the average savings from a similar group of participants (e.g., single-family, multifamily) may be used for claimed savings if: 1) the control event technology and intervention are the same, and 2) the control event intervention can be confirmed based on standard program practices for event confirmation. Utilities should notify the EM&V team in these circumstances to discuss the approach for determining and applying average savings for those customers with incomplete meter data.

Deemed Energy and Demand Savings Tables

Not applicable.

Claimed Peak Demand Savings

A summer peak period value is used for this measure, based on calculation methodology described for this measure.

Additional Calculators and Tools

Not applicable.

Measure Lifetime

Not applicable.

Program Tracking Data and Evaluation Requirements

The following data and information shall be tracked and provided to the EM&V team to enable savings verification:

- For each participant for which savings are being claimed, kWh consumption at intervals no greater than 30-minutes for each event day and for no less than five non-holiday and non-weekend days prior to each event day. Interval data shall be time-stamped with the date and no less than the time period ending the interval.
- Documentation describing the time stamp and whether the time stamp reflects the forward-looking period or period preceding the time stamp
- A list of all load management events affecting residential participants, describing their date, the time the event started, and the time the event ended.
- A list of all participants and addresses with a variable linking to the load or energy consumption interval data and that describes their enrollment date, load management control commissioning date, and any events in which the participant did not participate due to enrollment or equipment installation timing, equipment failures, or other factors known to the implementer or utility.
- Tools, calculators or other datasets that may be useful to the EM&V team, based on discussion between the EM&V team, utilities, and/or program implementer. The process for calculating kW and kWh savings should be provided in the program documentation, including any summation and rounding practices.
- Memos, reports, or results of any equipment test or metering data that provides perspectives, calculations, or metrics related to failure rates of load control receivers, thermostats or similar devices used to control participant loads during events.

The evaluation reserves the option to conduct participant level independent metering studies to inform the verification of load management program savings.

References and Efficiency Standards

Not applicable.

Petitions and Rulings

Not applicable.

Relevant Standards and Reference Sources

Not applicable.

Document Revision History

Table 50: M&V Residential Load Management History

TRM Version	Date	Description of Change
v2.1 Addendum	3/31/2015 revised 6/2015	Memo to PUCT staff initiating and establishing High 3 of 5 baseline with day-of adjustment.
v3.1	11/05/2015	TRM v3.1 Volume 4 origin.
v4.0	10/10/2016	Clarified language related to applying the adjustment factor to the High 3 of 5 baseline and additional data provision details
v5.0	10/10/2017	Further clarified the baseline calculation using the High 3 of 5 method.
v6.0	10/2018	No revisions.
v7.0	20/2019	Transferred metering and rounding guidance from Vol. 5.

2.5.2 Nonresidential Load Curtailment Measure Overview

TRM Measure ID: NR-LM-LM

Market Sector: Nonresidential

Measure Category: Load management

Applicable Building Types: Any building that meets minimum facility demand requirements (see Table 17)

Fuels Affected: Electricity

Decision/Action Type: Operation and maintenance (O&M)

Program Delivery Type: Custom

Deemed Savings Type: Not applicable

Savings Methodology: EM&V

Utilities operate nonresidential load management programs to obtain demand savings; to the extent energy savings are also estimated, they are estimated as a function of the estimated demand savings.³⁵ Demand savings calculations are performed using utility customer interval energy demand data from IDRs or advanced meters. Measured and verified demand savings for the curtailment period is presented here.

Measure Description

This document presents the deemed savings methodology for participation in a load management program that involves the curtailment of an interruptible load during the summer peak period. Project sponsors, who have agreed to deliver demand savings to the utility from the utility's customer, must commit to an availability of curtailed load throughout the Summer Peak Demand Period. These project sponsors may include national or local energy efficiency service providers (EESPs), retail electricity providers (REPs) or individual customers. Different utilities offer different details on their programs, but they all have similar eligibility criteria, listed below:

Eligibility Criteria

A project will be eligible for rebates under the Load Management SOP program if the following criteria are met:

Each meter included in a project must include a total potential demand savings of a specified minimum kW (varies by utility, as seen in Table 51) during the summer peak period.

³⁵ Some utilities may determine energy savings associated with load management events, which would be calculated as the difference between the baseline and curtailment kW values times the length of the event(s).

Table 51: Minimum Facility Demand Savings by Utility

Utility	Minimum Demand Savings [kW]
Oncor	100
TNMP	50 ³⁶
AEP (TNC, TCC & SWEPCO)	50
Xcel	100 ³⁷
CenterPoint	100
Sharyland	100
Entergy	250
El Paso Electric	100

Table 52: Peak Demand Period by Utility

Utility	Hours	Months	Exceptions
Oncor, AEP, TNMP, CenterPoint, Sharyland, Entergy, El Paso Electric	1:00PM—7:00PM	June, July, August, September	Weekends, federal holidays
Xcel	12:00PM—8:00PM ³⁸	June, July, August, September	Weekends, federal holidays

- A single project may involve identifying curtailable load at more than one customer facility, provided the curtailment demand savings at the facilities are recorded using a single interval data recorder (IDR).
- The project sponsor agrees to verify that the curtailable load that is being used in its application will not be used and counted in any other curtailable load or load management program during the duration of the customer contract. The project sponsor will notify the utility company within 15 business days of any change in the status of the curtailable load or its inclusion in another load management program.
- Curtailable load must produce demand savings through a curtailment of electrical consumption during the performance period.
- Project sponsors must commit to making the curtailable load available during the summer peak period for the program.

³⁶ TNMP prefers that project sponsors be capable of providing at least 50 kW of peak demand reduction at each site for which load reduction is offered; however, TNMP may accept applications including sites providing less than 50kW of peak demand reduction in the interest of meeting its peak load reduction targets.

³⁷ The utility prefers that project sponsors be capable of providing at least 100kW of peak demand reduction at each site for which load reduction is offered; however, the utility may accept applications including sites providing less than 100kW of peak demand reduction in the interest of meeting its peak load reduction targets.

³⁸ Note that although Xcel starts and ends events outside the 1 pm to 7 pm period, Xcel only claims savings for deliveries during the rule-defined 1-7 pm peak period.

- Be served by an interval data recorder (IDR) and/or smart meter that is monitored by the utility. A sponsor owned meter may be substituted in the event of a non-systemic utility-owned IDR meter failure. When using a sponsor owned meter, all data must otherwise conform to the High 5 of 10 method and be used for both the baseline and event-day calculations. Documentation of the case must be provided along with all supporting meter data.
- Customer agrees to respond to at least one event (scheduled or unscheduled) per year for the purpose of verifying the load reduction is available for potential calls. Scheduled events are used to provide an estimate of the load reduction in the event that no unscheduled interruptions occur during the season.
- For sponsors on a curtailment tariff, if the event or baseline periods include a tariff-based curtailment, the event day performance for the load management program will be net of firm delivery under the tariff. Documentation must be provided to describe the overlap of load management and tariff-based curtailments along with supporting firm delivery contract amounts.

The following loads are excluded from consideration:

- A customer who has load contracted with a REP where that contract prevents the load from participating in a curtailment
- Loads where curtailment would result in negative environmental or health effects
- Curtailable load that receives an incentive through any other energy efficiency program
- Curtailable load that takes electric service at transmission voltage and that serves a for-profit end-use customer

Baseline Condition

Standard facility operation.

High-efficiency Condition

Requires load management customers to participate in a certain number of unscheduled interruptions. Programs will provide a minimum of 30-minute advanced notice, allowing facility managers sufficient time to use non-automated approaches. Another option is for facilities to install a load-control device on specific end-uses, equipment, or circuit loads.

Additional Utility Program Details

Each utility in Texas provides slightly different guidelines for its load management program. These details differ in the length of the unscheduled interruptions (also called curtailments), the maximum number or maximum number of hours of unscheduled interruptions, and the length of notification provided to the project sponsor. Table 53 highlights these differences.

Each utility states that participants will be willing to participate in a maximum number of unscheduled interruptions, or a maximum number of scheduled (test) interruption hours. In addition to these, all utilities require that a scheduled interruption be performed. The purpose of this is to ensure that the project sponsor will be able to curtail the requested kW within the required notification time and to provide an estimate of the load reduction in the event that no

unscheduled interruptions occur during the season. Additionally, some of the utilities offer different baseline methods or options for their customers to choose from. These options are shown in Table 54 through Table 56.

Table 53: Utility Program Details Overview

Utility	Options Available	Scheduled Interruption Length	Maximum Length	Notification Required	Maximum Unscheduled Interruptions
Oncor	No	3 hours	4 hours	1 hour	25 hours
AEP (TCC & TNC)	See Table 54	1 hour	2 hours or 4 hours	1 hour	4, 8, or 12 interruptions
AEP SWPECO	See Table 55	1 hour	2 hours or 4 hours	1 hour	4 or 12 interruptions
TNMP	No	1-2 hours	4 hours	30 minutes	4 interruptions; 18 hours
CenterPoint	No	1-3 hours	4 hours	30 minutes	4 interruptions
Xcel	See Table 56	--	4 hours	1 hour	6 or 12 interruptions; 24 or 48 hours
Sharyland Utilities	No	1-2 hours	4 hours	1 hour	4 interruptions; 18 hours
Entergy	No	1 hour	4 hours	--	4 interruptions
El Paso Electric	No	1-5 hours	5 hours	1 hour	4 interruptions; 20 hours

Table 54: AEP (TNC & TCC) Interruption Options

Option	Maximum Number of Unscheduled Interruptions	Minimum Length (hours)	Maximum Length (hours)
A	4	1	4
B	12	1	4
C	12	1	2
D	8	1	4
E	8	1	2

Table 55: AEP (SWEPCO) Interruption Options

Option	Maximum Number of Unscheduled Interruptions	Minimum Length (hours)	Maximum Length (hours)
A	4	1	4
B	12	1	4

Table 56: Xcel Interruption Options

Option	Maximum Number of Unscheduled Interruptions	Maximum Length (hours)
A	6	4
B	12	4

Energy and Demand Savings Methodology

Savings Algorithms and Input Variables

Utilities operate load management programs to obtain demand savings: to the extent energy savings are also estimated, they are estimated as a function of the estimated demand savings.³⁹ Demand savings calculations are performed using utility customer interval energy usage data from IDRs or advanced meters. The verified demand savings for the curtailment period uses the following algorithm:

$$\text{Verified Demand Savings} = \text{Baseline Period kW} - \text{Curtailment kW}$$

Equation 61

Where:

Baseline Period kW = *Baseline average demand calculated according to the High 5 of 10 baseline method, detailed below*

Curtailment kW = *Average demand measured during the curtailment period*

High 5 of 10 baseline (High x of y method) with day-of adjustment:

A High X of Y baseline considers the Y most recent days preceding an event and uses the data from the X days with the highest load within those Y days to calculate the baseline. Day-of adjustments are used to scale the baseline load estimate to the load conditions on the day of the event using data from the hours prior to the time on the event day when participants were notified of the pending call for curtailment.

Applying this concept to the load management measure, the high 5 of 10 baseline for a given curtailment event is estimated by first identifying the 10 non-holiday weekdays immediately preceding the event in which no prior program curtailment events were called, and calculating each participant's average demand during the same hours as the hours for which the curtailment event was implemented on each of those 10 days. The five highest of these ten average demand values are then averaged to estimate the "unadjusted high five baseline".

The day-of baseline adjustment is estimated by comparing participants' average demand for electricity on the day of the event during the two hours prior to notification of the pending event (the "adjustment period") to participants' average demand for electricity on the "high five" days

³⁹ Some utilities do determine energy savings, which would be calculated as the difference between the baseline and curtailment kW values times the length of the event(s).

during those same two hours. The difference (positive or negative) between day-of demand and high five demand in the adjustment period is the “uncapped additive adjustment”. In the situation where notification may not be given, the two hours preceding one hour before the event begins on the event day and baseline days will be used as the adjustment period. The average load of the adjustment period on the event day are compared to the average load of the adjustment periods from the baseline days. The difference (positive or negative) between day-of demand and high three baseline day demand in the adjustment period is the uncapped additive adjustment. To apply the adjustment period to the unadjusted baseline, one of two options are selected in the following steps:

- 1) Calculate an uncapped additive adjustment. The uncapped additive adjustment is the difference of the adjustment period hours’ load of the event day subtracted from the baseline days’ average adjustment period load. For example, if the baseline days have an adjustment period average load of 530.20 kW and the event day has an adjustment period load of 575.80 kW, the uncapped additive adjustment is $575.80 \text{ kW} (-) 530.20 \text{ kW} = 45.60 \text{ kW}$.
- 2) Calculate an adjustment cap. The adjustment cap is 50 percent of the baseline days’ average load during the event hours. For example, if a participant has a load of 504.00 kW during the baseline days’ event hours, the adjustment cap is $504.00 \text{ kW} (x) 0.50 = 252.00 \text{ kW}$.
- 3) Select the lowest of the adjustment cap and the absolute value of the uncapped additive adjustment to be the additive adjustment. Using the examples of the preceding two steps, the uncapped additive adjustment (45.60 kW) has the lowest magnitude between the two numbers and is selected as the additive adjustment.
- 4) Add the additive adjustment to the unadjusted High 5 of 10 baseline to calculate the final baseline used for calculating savings.

An example, below, illustrates the entirety of applying the High 5 of 10 method to calculate load management savings for a single residential participant.

Example Calculation

Table 57 serves to illustrate the steps of the High 5 of 10 baseline calculation method. Specific participant’s results may vary. Numbers from the table in bold font represent data selected for the calculation.

Table 57. High 5 of 10 Example Load Management Event Data

Event Day and Potential Baseline Days	Load Mgmt. Event Date	Potential Baseline Day 1	Potential Baseline Day 2	Potential Baseline Day 3	Potential Baseline Day 4	Potential Baseline Day 5
Event Hours	1500-1600	1500-1600	1500-1600	1500-1600	1500-1600	1500-1600
Average kW During Event Hours	1078.89	990.57	919.45	926.36	892.42	880.13
Notification Hour	1400					
Adjustment Period Hours	1200-1400	1200-1400	1200-1400	1200-1400	1200-1400	1200-1400
Adjustment Period Average kW	959.39	752.26	672.08	637.98	695.12	698.88
Event Day and Potential Baseline Days	Potential Baseline Day 6	Potential Baseline Day 7	Potential Baseline Day 8	Potential Baseline Day 9	Potential Baseline Day 10	
Event Hours	1500-1600	1500-1600	1500-1600	1500-1600	1500-1600	
Average kW During Event Hours	950.63	842.19	1008.69	795.80	1049.24	
Notification Hour						
Adjustment Period Hours	1200-1400	1200-1400	1200-1400	1200-1400	1200-1400	
Adjustment Period Average kW	657.64	539.75	801.02	647.12	850.18	

Calculation Steps:

- 1) Unadjusted High Five Baseline = Average kW during event times in five highest days of ten prior to event day (kW)

$$\text{Unadjusted High Five Baseline} = (990.57 + 926.36 + 950.63 + 1008.69 + 1049.24) / 5 = 985.10 \text{ kW}$$

- 2) Uncapped Additive Adjustment = Average kW during adjustment time on event day (kW)—Average kW during adjustment time in the same five highest days of ten prior to event day

$$\text{Uncapped Additive Adjustment} = 959.39 - (752.26 + 637.98 + 657.64 + 801.02 + 850.18) / 5 = 219.57 \text{ kW}$$

- 3) Adjustment Cap = 50% of Unadjusted High Three Baseline (kW)

$$\text{Adjustment Cap} = 0.5 * 985.10 = 492.55 \text{ kW}$$

- 4) Choose Additive Adjustment = Minimum {Absolute value of Uncapped Additive Adjustment, Adjustment Cap} (kW)

$$\text{Additive Adjustment} = \text{Minimum} \{219.57, 492.55\} = 219.57 \text{ kW}$$

- 5) Final Baseline = Additive Adjustment + Unadjusted High Three Baseline (kW)

$$\text{Final Baseline} = 219.57 + 985.10 = 1204.67 \text{ kW}$$

- 6) kW Savings = Final Baseline—Curtailment kW (kW)

$$\text{kW Savings} = 1204.67 - 1078.89 = 125.78 \text{ kW}$$

Additional Calculation Considerations

In the case that individual meters fail to record data sufficient for applying the High 5 of 10 calculation method, savings will not be calculated.

When selecting baseline days in the High 5 of 10 method, in some cases it is possible that some days have the same load for an individual participant, potentially leading to more than five days that could be selected for the baseline days. In the event that six or more days could be selected as baseline days based on their loads during event hours, the days with the highest loads and closest to the event should be picked for the baseline.

Program year kW load management event savings will be calculated as the sum of each sponsor's average savings of all events in which the sponsor participated.

Rounding

Utilities should round commercial load management impacts consistent with how incentives are awarded, which is at the customer-level.

Meters

Utilities are responsible for calling a test event each program year for the load management programs. The test event has several purposes, including assuring the proper functioning of program meters. Utilities are responsible for maintaining working program meters.

Without complete interval meter data to calculate the baseline and event impacts, savings may not be claimed. However, if a customer has alternate interval meter data available, this can be used in lieu of program meter data to calculate claimed savings. Using customer meters for the load management program savings requires that the data meet interval metering requirements presented in the version of the Texas TRM for the program year. In general, it is recommended that customer owned interval meters should only be used if utility interval meters fail. Data from each should not be combined for claiming savings for a specific event and must be able to cover both the event day data and baseline data.

The EM&V team requests utilities notify them in these circumstances. All calculations and data stemming from the use of customer meters should be provided as part of the EM&V data request similarly to when program meter data is used. If requested by the utility, the EM&V team

is available to review the use of customer meter data in advance of a program claiming savings from customer meters.

Measure Life and Lifetime Savings

Not applicable.

Program Tracking Data and Evaluation Requirements

- IDR or Advanced Meter data associated with the project will be provided by the project sponsor or retrieved by the utility following an event. Depending on the utility, the data will be provided at 30-minute increments (or smaller) to evaluate both baseline demand usage and demand usage during curtailment.
- Documentation describing the time stamp and whether the time stamp reflects the forward-looking period or period preceding the time stamp
- Utilities should provide a description of their practices related to whether scheduled or test events are or are not included in their program year kW savings results. kWh savings will be calculated from all events.
- A list of all load management events affecting nonresidential participants within the program year, describing the date of each event, the time the event started, and the time the event ended.
- A list of all participants and addresses with a variable linking to the load or energy consumption interval data and that describes their enrollment date, load management control commissioning date, and any events in which the participant did not participate due to enrollment or equipment installation timing, equipment failures, or other factors known to the implementer or utility.
- Tools, calculators or other datasets that may be useful to the EM&V team, based on discussion between the EM&V team, utilities, and/or program implementer. The process for calculating kW and kWh savings should be provided in the program documentation, including any summation and rounding practices.

References and Efficiency Standards

Petitions and Rulings

Not applicable.

Relevant Standards and Reference Sources

- El Paso Electric: EOE 2010 Load Management Program Manual.
http://www.epelectricityefficiency.com/files/EPE_LM_10_ProgramManual.pdf. Accessed 09/06/2013.
- AEP: Texas North Company Load Management SOP 2013 Program Manual.
http://www.aepefficiency.com/loadmanagement/TNC/2013_TNC_LM%20Manual_Agreement.pdf. Accessed 02/28/14. Manual no longer available online.

- AEP: Texas Central Company Load Management SOP 2013 Program Manual. http://www.aepefficiency.com/loadmanagement/TCC/2013_TCC_LM_Manual_Agreement.pdf. Accessed 09/06/2013. Manual no longer available online.
- AEP: Southwestern Electric Power Company Load Management 2013 Program Manual. http://www.swepcogridsmart.com/texas/downloads/Load%20Management_Program_Manual.pdf. Accessed 09/06/2013. Manual no longer available online.
- Entergy: 2013 Load Management Handbook. http://www.entergy-texas.com/content/energy_efficiency/documents/Load_Management_Handbook.pdf. Accessed 09/06/2013. Manual no longer available online.
- CenterPoint: EnergyShare 2013 Program Manual. http://www.centerpointelectric.com/staticfiles/CNP/Common/SiteAssets/doc/2013_Load_Management_Program_Manual.pdf. Accessed 09/06/2013.
- Texas-New Mexico: Load Management 2013 SOP. http://tnmpefficiency.com/downloads/Load_Management_Program_Manual.pdf. Accessed 09/06/2013.
- Xcel Energy: 2013 Load Management Pilot Standard Offer Program. http://www.xcelefficiency.com/TX/Xcel_LM_Manual_2013.pdf. Accessed 09/06/2013; pilot program has been replaced. Manual no longer available online.
- Sharyland Utilities: 2013 Load Management SOP. http://www.sharylandefficiency.com/load-management/Sharyland_2013_Peak_Load_Mgmt_Program_Manual.pdf. Accessed 09/06/2013; 2013. Manual no longer available online.
- Oncor: Commercial Load Management Standard Offer Program. <https://www.oncoreepm.com/load-management-program.aspx>. Accessed 09/06/2013.

Document Revision History

Table 58: M&V Nonresidential Load Management History

TRM Version	Date	Description of Change
v3.0	4/10/2015	The baseline calculation methodology was modified to be the highest 5 of 10 prior days for all the programs. In addition, a new day-of adjustment factor was added with an adjustment cap.
v3.1	11/05/2015	TRM v3.1 Volume 4 origin.
v4.0	10/10/2016	Clarified language related to applying the adjustment factor to the High 5 of 10 Baseline and additional data provision details.
v5.0	10/10/2017	Updated equation, figure, and table references.
v6.0	10/2018	No revisions.
v7.0	10/2019	Transferred metering and rounding guidance from Vol 5.

APPENDIX A: M&V METERING SCHEDULE

1.0 Arrive on site and meet customer

- 1.1 Turn unit on to stabilize and make sure the unit is in full cooling mode (Variable speed blowers are on high and all compressors in multi-compressor systems are operating).
- 1.2 Record customer information:
 - a. Address
 - b. City
 - c. Zip
 - d. County
 - e. Email
 - f. Utility Account Number (from utility bill)
 - g. Altitude [ft]
 - h. Residential Program or Commercial Program
 - i. Building Type
 - j. Phone Number

2.0 Test In: Perform TI procedure to determine system's baseline cooling capacity and energy efficiency ratio (EER).

- 2.1 Record Unit Information
- 2.2 Measure and record airflow using 1 of the following methods:
 - a. Air Flow Method 1: Handheld Anemometer
 - b. Air Flow Method 2: Generic Fan Chart
- 2.3 Air Flow Power Consumption
 - a. Determine the blower motor type as either "PSC" or "ECM."
 - b. Measure and record the blower voltage and current.
- 2.4 Condenser and Compressor Measurements
 - a. Compressor Type (Scroll or Reciprocating)
 - b. Refrigerant Type (R22 or R410)
 - c. Metering Device (Fixed Orifice, TXV or Capillary Tube)
 - d. Condenser Model Number
 - e. Condenser Serial Number
 - f. Compressor Phase (Single or Three)
 - g. Multiple Compressor System (Check box for participating utilities)
 - h. Measure and Record Compressor Volts
 - i. Measure and Record Compressor Current
 - j. Measure and Record Ambient Air Dry Bulb Temperature
 - k. Measure and Record Ambient Air Wet Bulb Temperature if Required
- 2.5 Enter Information from Refrigerant Analyzer:
 - a. Suction Pressure [PSI]
 - b. Discharge Pressure [PSI]
 - c. Evaporator Temperature [°F]
 - d. Condenser Temperature [°F]
 - e. Vapor Line Temperature (VLT) [°F]
 - f. Liquid Line Temperature (LLT) [°F]
 - g. Superheat [°F]
 - h. Subcooling [°F]
- 2.6 Measure and Record Supply and Return Air Conditions:
 - a. Return Air Dry Bulb Temperature [°F]
 - b. Return Air Wet Bulb Temperature [°F]
 - c. Supply Air Dry Bulb Temperature [°F]
 - d. Supply Air Wet Bulb Temperature [°F]
- 2.7 Review System Performance

3.0 Perform Corrective Measures as Needed

- 3.1 Clean Condenser—required
- 3.2 Clean Evaporator—required
- 3.3 Clean Blower—required
- 3.4 Verify clean filter: change or clean as needed—required
- 3.5 Verify Airflow within range (+/- 15% of 400 cfm/ton)—required
- 3.6 Check refrigerant charge; adjust to Manufacturer's Spec's as needed

4.0 Test Out: The Test Out (TO) procedure requires measurements that are used to determine the performance characteristics of the cooling system after all corrective measures have been implemented.

- 4.1 Air Flow—Use same method as Test In
- 4.2 Air Flow Power Consumption
 - a. For ECMs, make sure it is operating in full cooling mode during the entire tune-up.
 - b. Measure and record the blower voltage and current.
- 4.3 Measure and record Supply and Return Air Conditions:
 - a. Return Air Dry Bulb Temperature [°F]
 - b. Return Air Wet Bulb Temperature [°F]
 - c. Supply Air Dry Bulb Temperature [°F]
 - d. Supply Air Wet Bulb Temperature [°F]
- 4.4 Condenser and Compressor Measurements
 - a. Compressor Volts
 - b. Compressor Current
 - c. Ambient Air Dry Bulb Temperature
 - d. Ambient Air Wet Bulb Temperature
- 4.5 Information from Refrigerant Analyzer:
 - a. Suction Pressure [PSI]
 - b. Discharge Pressure [PSI]
 - c. Evaporator Temperature [°F]
 - d. Condenser Temperature [°F]
 - e. Vapor Line Temperature (VLT) [°F]
 - f. Liquid Line Temperature (LLT) [°F]
 - g. Superheat [°F]
 - h. Subcooling [°F]
- 4.6 Review System Performance

5.0 Generate invoice: A customer signed invoice is required for participation in the program. The following information must be shown on the invoice:

- 5.1 Customer Address
- 5.2 Contractor Name and Address
- 5.3 Project Number Listed on the DCVF
- 5.4 Corrective Measures Performed
- 5.5 Charge for Services Performed
- 5.6 Rebate Amount Applied to Charges

APPENDIX B: COUNTIES BY WEATHER ZONE ASSIGNMENT

County Name	Zone	County Name	Zone	County Name	Zone	County Name	Zone
Anderson	2	Brown	2	Cooke	2	Falls	2
Andrews	2	Burleson	3	Coryell	2	Fannin	2
Angelina	2	Burnet	2	Cottle	1	Fayette	3
Aransas	4	Caldwell	3	Crane	2	Fisher	2
Archer	2	Calhoun	4	Crockett	2	Floyd	1
Armstrong	1	Callahan	2	Crosby	1	Foard	1
Atascosa	3	Cameron	4	Culberson*	2 & 5	Fort Bend	3
Austin	3	Camp	2	Dallam	1	Franklin	2
Bailey	1	Carson	1	Dallas	2	Freestone	2
Bandera	2	Cass	2	Dawson	2	Frio	3
Bastrop	3	Castro	1	De Witt	3	Gaines	1
Baylor	2	Chambers	3	Deaf Smith	1	Galveston	3
Bee	3	Cherokee	2	Delta	2	Garza	1
Bell	2	Childress	1	Denton	2	Gillespie	2
Bexar	3	Clay	2	Dickens	1	Glasscock	2
Blanco	2	Cochran	1	Dimmit	3	Goliad	3
Borden	2	Coke	2	Donley	1	Gonzales	3
Bosque	2	Coleman	2	Duval	4	Gray	1
Bowie	2	Collin	2	Eastland	2	Grayson	2
Brazoria	3	Collingsworth	1	Ector	2	Gregg	2
Brazos	3	Colorado	3	Edwards	2	Grimes	3
Brewster	2	Comal	3	El Paso	5	Guadalupe	3
Briscoe	1	Comanche	2	Ellis	2	Hale	1
Brooks	4	Concho	2	Erath	2	Hall	1

* Up to the town of Van Horn is in EPE's territory

County Name	Zone	County Name	Zone	County Name	Zone	County Name	Zone
Hamilton	2	Jasper	2	Leon	2	Montague	2
Hansford	1	Jeff Davis	2	Liberty	3	Montgomery	3
Hardeman	1	Jefferson	3	Limestone	2	Moore	1
Hardin	3	Jim Hogg	4	Lipscomb	1	Morris	2
Harris	3	Jim Wells	4	Live Oak	3	Motley	1
Harrison	2	Johnson	2	Llano	2	Nacogdoches	2
Hartley	1	Jones	2	Loving	2	Navarro	2

County Name	Zone	County Name	Zone	County Name	Zone	County Name	Zone
Haskell	2	Karnes	3	Lubbock	1	Newton	2
Hays	2	Kaufman	2	Lynn	1	Nolan	2
Hemphill	1	Kendall	2	Madison	3	Nueces	4
Henderson	2	Kenedy	4	Marion	2	Ochiltree	1
Hidalgo	4	Kent	1	Martin	2	Oldham	1
Hill	2	Kerr	2	Mason	2	Orange	3
Hockley	1	Kimble	2	Matagorda	3	Palo Pinto	2
Hood	2	King	1	Maverick	3	Panola	2
Hopkins	2	Kinney	3	McCulloch	2	Parker	2
Houston	2	Kleberg	4	McLennan	2	Parmer	1
Howard	2	Knox	1	McMullen	3	Pecos	2
Hudspeth	5	La Salle	3	Medina	3	Polk	3
Hunt	2	Lamar	2	Menard	2	Potter	1
Hutchinson	1	Lamb	1	Midland	2	Presidio	2
Irion	2	Lampasas	2	Milam	3	Rains	2
Jack	2	Lavaca	3	Mills	2	Randall	1
Jackson	3	Lee	3	Mitchell	2	Reagan	2
Real	2	Shackelford	2	Titus	2	Wharton	3
Red River	2	Shelby	2	Tom Green	2	Wheeler	1
Reeves	2	Sherman	1	Travis	2	Wichita	2
Refugio	4	Smith	2	Trinity	3	Wilbarger	1
Roberts	1	Somervell	2	Tyler	3	Willacy	4
Robertson	2	Starr	4	Upshur	2	Williamson	2
Rockwall	2	Stephens	2	Upton	2	Wilson	3
Runnels	2	Sterling	2	Uvalde	3	Winkler	2
Rusk	2	Stonewall	1	Val Verde	3	Wise	2
Sabine	2	Sutton	2	Van Zandt	2	Wood	2
San Augustine	2	Swisher	1	Victoria	3	Yoakum	1
San Jacinto	3	Tarrant	2	Walker	3	Young	2
San Patricio	4	Taylor	2	Waller	3	Zapata	4
San Saba	2	Terrell	2	Ward	2	Zavala	3
Schleicher	2	Terry	1	Washington	3		
Scurry	2	Throckmorton	2	Webb	4		